

1 **REVIEWING THE APPLICATION OF MULTI-BARRIER MEMBRANE**  
2 **FILTRATION TECHNOLOGIES TO RECLAIM MUNICIPAL WASTEWATER**  
3 **FOR INDUSTRIAL WATER USE**

4

5 Ruth Ordóñez<sup>a</sup>, Daphne Hermosilla<sup>a</sup>, Noemí Merayo<sup>a</sup>, Antonio Gascó<sup>b</sup>, Carlos Negro<sup>a</sup>  
6 and Ángeles Blanco<sup>a</sup>

7

8 <sup>a</sup>Department of Chemical Engineering, Universidad Complutense of Madrid,  
9 Avda. Complutense, s/n. 28040 Madrid, Spain.

10

11 <sup>b</sup>IE University, B.Sc. in Biology, Campus de Santa Cruz la Real, Cardenal Zúñiga 12,  
12 40003 Segovia, Spain.

13

14 Running Head: **Reclaimed sewage for industrial use**

15

16 Address correspondence to Prof. Daphne Hermosilla, Dept. of Chemical Engineering,  
17 Complutense University of Madrid, Avda. Complutense s/n. 28040 Madrid, Spain. Tel.:  
18 (+34) 91 394 4245; Fax: (+34) 91 394 4243; E-mail: [dhermosilla@quim.ucm.es](mailto:dhermosilla@quim.ucm.es)

19

1 **ABSTRACT**

2 The significant percentage of the world’s water consumption devoted to industrial use,  
3 along with an increasingly higher environmental concern of society, have awakened the  
4 interest of industry on using municipal reclaimed water for replacing fresh water use  
5 coming from utilities or natural resources. Depending on the type of industry and the  
6 specific application, water must meet certain quality requirements. Therefore, those  
7 water quality standards that are required for those most relevant industrial applications  
8 wherein the use of reclaimed water has noticeably been reported are herewith reviewed.  
9 Although the use of internal water treatments for recycling and reusing their own  
10 effluents has recently and widely been reported within many industrial sectors  
11 worldwide, the substitution of fresh water by reclaimed municipal wastewater has not  
12 been much extended yet. The increasing proportion of municipal wastewater  
13 reclamation plants that rely on membrane filtration technologies versus the total number  
14 of reclamation facilities that are worldwide distributed is also assessed within this  
15 review, including the discussion of their main related drawbacks.

16

17 *Keywords:* membrane filtration, municipal wastewater reclamation, industrial water  
18 quality, ultrafiltration, reverse osmosis.

19

## 1. INTRODUCTION

Water shortage, an increasing population, and a more stringent legislation regarding water conservation and environmental compliance, are imposing severe restrictions to industrial water use since its activity entails about a quarter of the world's total water consumption (1). Moreover, predictions inferred from climate change considerations may even suppose more stringent water use policies in the short term because a significant impact is expected on water resources quality and availability (2).

Although water recycling within industrial facilities leads to reduce water consumption figures, it is very difficult to achieve a total closure of their water circuits because residual contaminants eventually accumulate in reused water (3), and fresh water intake is always somewhat needed to compensate losses (e.g. by evaporation) in any case (4). As a consequence, and despite industrial process-water consumption is progressively being reduced as a result of a higher closure level of water circuits, the demand for this resource will still be large in the close future. Fortunately, the remaining water demand after closing water circuits might alternatively be satisfied by reclaimed water from municipal sewage treatment plants in many cases.

Despite its great application potential, the market for reclaimed water is nowadays still awaiting a wider exploitation. The major factors limiting the use of reclaimed water in industry are: availability to ensure continuous operation without water shortage, meeting quality standards, volume, cost, and reliability (5, 6). In short, reclaimed water use only satisfied about the 0.4% of the total water use worldwide demanded for industrial purposes in 1995 (7); whereas this alternative only reached the 1% ten years later (2005) (8). Agriculture is the main user of reclaimed water (70%), followed by industry (20%), and domestic uses (10%) (9).

1           Beyond these average figures, there are strong significant differences among how  
2 the volume of reclaimed wastewater is distributed in each country. For example, Tunisia  
3 devotes an 86% water use for agricultural purposes, for which a 30-45% of the treated  
4 sewage is also used (10). On the other hand, USA, Singapore, and Germany,  
5 respectively devote a 45%, 51% and 69% of their fresh water capacity to industrial  
6 purposes, and many recycling and reuse projects have therefore been implemented  
7 within their industry (9). Finally, only about the 10% of the fresh water resource of  
8 Spain is consumed by industrial applications (11). Correspondingly, only a 0.3% of the  
9 Spanish reclaimed sewage capacity was consumed by industry in 2009 ( $\approx 1 \text{ hm}^3/\text{year}$ )  
10 (12); although an enterprising plan aiming to boost the use of reclaimed water in all  
11 sectors is currently being implemented, estimating an accumulated industrial use of 38  
12  $\text{hm}^3/\text{year}$  (6.2%) at a 2015 horizon (12).

13           In tune with these considerations, there is much available information regarding  
14 municipal wastewater reclamation initiatives for irrigation purposes in agriculture or  
15 environmental applications (13-15); as well as for implementing treatments to reclaim  
16 the effluent within specific industrial facilities (16-18). However, the use of reclaimed  
17 municipal wastewater for industrial applications is still much less extended; with the  
18 exception of cooling systems, where municipal reclaimed water has been used from  
19 long time ago after a conventional tertiary treatment (19). In addition, reclaimed  
20 municipal water has been also used in several other industrial auxiliary applications,  
21 significantly replacing fresh water intake, such as washing and flushing, and in general  
22 cleaning and watering plants (7, 8).

23           Nevertheless, the interest in using reclaimed sewage as industrial process water is  
24 expected to increase in the close future, provided its economical (4, 20-21) and constant  
25 quality features (21), and new initiatives being developed and reported within several

1 industrial sectors (4, 20, 22, 23). Particularly, it may represent a very interesting  
2 alternative for industrial facilities located within areas suffering water scarcity;  
3 furthermore when authorities (24) and climate change forecast (2) are progressively  
4 imposing more stringent limitations to fresh water consumption. In short, many  
5 companies may also find that the substitution of fresh water by municipal reclaimed  
6 water may be an economically feasible complement to compensate water losses within  
7 their own closed circuits, and/or a good alternative to building on-site specific  
8 treatments for recycling their own effluents (4, 23).

9 In general terms, guidelines defining water quality parameters that reclaimed  
10 water must fulfil for its different potential use alternatives follow two main orientations:  
11 (a) those who prefer limiting health hazard to the maximum extent possible, being the  
12 “*Californian Title 22*” (24) regulation a major example; and (b) those who pretend to be  
13 more realistic and feasible, such as the World Health Organisation’s “*Guidelines for the*  
14 *safe use of wastewater and excreta in agriculture and aquaculture*” (1989) (10). In  
15 short, most countries (even states or regions within) have developed their own  
16 guidelines regarding the use of reclaimed water combining quality standards from both  
17 legislation types, so there are no universal water quality standards defined (20).

18 Nevertheless, although every state has its own legislation within the USA, all of  
19 them are collected within the “*Guidelines for Water Reuse*” (25). Correspondingly,  
20 some Australian jurisdictions have together implemented the “*Australian Guidelines for*  
21 *Water Recycling: Managing Health and Environmental Risks*” (26); as well as they  
22 have developed specific validation requirements for recycled water schemes (27). On  
23 the other hand, there are no current formal definitions or guidelines for water reuse at  
24 the European level. Conversely, there are very different water reuse practices from  
25 North to South, and even among Mediterranean countries (28). In fact, the European

1 Union is at least making a big effort to solve this legislation disagreement creating the  
2 “*Mediterranean-EU Water Initiative Working Group for Wastewater Reuse*”, which is  
3 first one collecting information regarding the current status of wastewater reuse within  
4 the EU and the Mediterranean area in order to implement specific demand-driven  
5 actions (29). Within this framework, “*Aquarec*” EU’s project has defined seven water  
6 quality categories including microbial and chemical limits for each one (30).

7 Despite water quality guidelines for industrial use differ among countries and the  
8 standards required for each specific application, health hazard is the main issue that is  
9 always mentioned within all available legislations because special attention should be  
10 paid when workers might be in direct contact with water. In this sense, both  
11 “*Californian Title 22*” and the Australian guidelines define a minimal water reclamation  
12 process based on a secondary treatment followed by coagulation-flocculation, filtration  
13 or flotation, and disinfection. On the other hand, they differ in the limits related to the  
14 allowed presence levels of microorganisms. For example, “*Californian Title 22*”  
15 establishes a total coliforms threshold of <23 colony-forming units (CFU)/100 mL for  
16 specific sampling (<2.2 weekly) (24); whereas the Australian standards set <10  
17 CFU/100 mL for *E. Coli* (26); but both legislations agree limiting turbidity to <2 NTU.

18 Beyond these considerations, current reclamation treatment trends are focused on  
19 obtaining the highest water polishing grade in order to avoid any health hazard or  
20 operational risk. In this sense, membrane processes (microfiltration, MF; ultrafiltration,  
21 UF; nanofiltration, NF; and reverse osmosis, RO) are taking competitive advantage over  
22 those physico-chemical processes specified in historically used standards within  
23 municipal wastewater treatment plants (mWWTP) (9). In short, membrane processes  
24 produce high quality water regardless the variations in the characteristics of the  
25 inflowing feed water in comparison to other treatment processes (31). Particularly, MF

1 and UF are applied as the preferred processes for the retention of microbial and  
2 suspended solids; and as pre-treatments for NF or RO stages, which are able to generate  
3 process water with a very high quality standard, even drinking water (32, 33).

4 Industrial water use is herein reviewed considering water quality requirements for  
5 different uses, and the possibility of using municipal reclaimed water as an alternative  
6 to fresh water use. Municipal wastewater reclamation facilities that produce treated  
7 water for industrial purposes are also located worldwide providing an overall water  
8 reclamation assessment. In particular, membrane filtration alternatives, including their  
9 potential drawbacks, for reclaiming municipal wastewater for industrial purposes are  
10 also reviewed, provided these technologies are currently taking the lead within the  
11 alternatives to polish sewage.

## 12

## 13 **2. ASSESSING CURRENT AND POTENTIAL APPLICATIONS FOR**

## 14 **RECLAIMED MUNICIPAL WASTEWATER IN INDUSTRY**

15 Most standards for water use are set to maintain a proper operation of industrial systems,  
16 to preserve the quality of manufactured products, and to protect public and  
17 environmental health. Main water quality guidelines that are applicable to major  
18 industrial water consumers are reviewed next.

### 19

### 20 **2.1 Utilities**

#### 21 **2.1.1 Cooling water**

22 More than 50% of the fresh water consumed by industry is used for cooling (34).  
23 Power generation plants, petroleum refineries, chemical manufacturers, metal  
24 processors, and food (i.e. mainly meat and dairy products) and beverage manufacturers,  
25 are the major consumers of cooling water. In 2004, power generators from the USA

1 accounted for approximately the 40% of the freshwater withdrawal within the country  
2 (35). Although this value finally only accounts for about the 3% of the total freshwater  
3 consumption in the USA (the rest 37% is returned back), it still represents a significant  
4 demand of freshwater use (36). The United States Environmental Protection Agency  
5 (USEPA) established the cooling tower water quality requirements within their  
6 “*Guidelines for water reuse*” (EPA/625/R-92/004), published in 1992 (37) (Table 1),  
7 which have not been modified so far.

8 Figure 1 shows water use intensity for different fuel types and cooling systems in  
9 thermoelectric power plants where cooling towers are typically placed (38). In short, the  
10 amount of required water depends on the type of cooling system and the efficiency of  
11 the turbine, which increases as the difference between steam and condensation  
12 temperatures increases as well. Therefore, more efficient plants require less cooling  
13 effort to produce the same amount of energy. For example, coal plants nowadays  
14 operate at higher temperatures than nuclear ones, so they consume less water.

15 In recirculating cooling systems, such as cooling towers or spray ponds, water  
16 evaporates as it dissipates process heat, so the water solution become concentrated  
17 many times (typically 4-8 times) (39). As a consequence of both an elevated  
18 concentration of diverse matter and such high water temperature, scaling, corrosion and  
19 biofouling trouble may be promoted in the system. Particularly, ammonia is a critical  
20 compound that may form metal complexes affecting metals solubility and release, as  
21 well as it may also promote biological growth and bio-corrosion. In fact, it is especially  
22 corrosive to copper alloys at a concentration greater than 2 mgN/L (40). In addition,  
23 silica may precipitate when its concentration threshold favours silicic acid  
24 polymerization until the solubility limit of amorphous silica is reached, which is further  
25 decreased by the presence of trace amounts of aluminum (41); as well as iron content is

1 able to deactivate polymers that are used to inhibit calcium phosphate scaling (421).  
2 Finally, organic matter content thresholds that may induce the formation of metal  
3 complexes, which may further increase metal release as well, or promote biological  
4 growth and consequent bio-corrosion trouble in cooling systems, may be controlled  
5 monitoring total organic carbon (TOC) concentration in the solution (1).

6 Moreover, cooling water systems (particularly open recirculating ones such as  
7 cooling towers) provide a favourable environment (i.e. T= 25-45 °C; pH= 5.5-8.5) for  
8 the growth of bacteria, algae, fungi, protozoa, and viruses (43-44); being the gram  
9 negative aerobic bacteria *Legionella pneumophila* especially dangerous for public  
10 health, as it is the responsible to cause the fatal infectious *Legionellosis* disease. All  
11 these microorganisms can be drifted into the environment through cooling equipment  
12 aerosols causing other diverse illnesses (45-49). In short, all of them may enter the  
13 system in makeup water, through the air, or from process leaks; and they will then begin  
14 to proliferate if an effective preventive monitoring and maintenance programme is not  
15 implemented. Finally, microbial growth on wetted surfaces ultimately leads to the  
16 formation of biofilms, which are made up by the accumulation of microorganisms  
17 themselves, extra-cellular secreted products, and other organic and inorganic debris.  
18 These biofilms affect equipment performance adversely and also promote metal  
19 corrosion (43, 50-51).

20 The key to limit bio-growth, and the consequent slime formation, in any water  
21 system reside in controlling nutrients contents circulating in water streams. Besides  
22 nitrogen- and phosphorous-based compounds, nutrients may be provided by scale (Ca  
23 and Mg based), suspended solids, corrosion products, or trapped organic or inorganic  
24 molecules supplied by the incoming water (43). Although corrosion and scaling are  
25 relatively easy to control in cooling systems keeping water chemical contents under the

1 values reported in Table 1 (37), corrosion inhibitors and sequestering agents are  
2 normally added to their water circuits. In order to avoid biological contamination, it is  
3 really important to initiate an appropriate biocide treatment program at system's start-  
4 up; and continue thereafter on a regular basis following the instructions received from  
5 the supplier of the implemented biocide treatment (52).

6

### 7 **2.1.2 Boiler-feed water**

8 Water quality requirements for boilers are clearly more restrictive than those for cooling  
9 water (Table 1) (37) due to the higher temperatures and pressures that are required for  
10 steam production; particularly when the heat source is in direct contact with the tubes.  
11 As boiler-feed water quality requirements depend on the applied pressure, more  
12 restrictive water quality figures are in general required at higher pressures (38).

13 In short, those critical quality parameters that have been associated to boiler water  
14 use are alkalinity, and silica, iron, manganese, and copper (37, 38). Two operational  
15 problems have been associated to high alkalinity figures: (a) as water temperature  
16 increases, CO<sub>2</sub> is released increasing corrosion potential; and (b) carbonate can  
17 contribute to foaming, which leads to deposit formation in the superheater, reheater,  
18 and/or turbines (1). In addition, silica can form scale if pressure is below 600 psig.  
19 Above this threshold, silica starts to volatilize, passing over with steam to potentially  
20 form deposits on the steam turbine diaphragms and blades (53). Finally, the most  
21 common type of galvanic corrosion that is found in boiler systems is that caused by the  
22 contact of dissimilar metals, such as iron and copper (53).

23

### 24 **2.1.3 Sealing water**

25 The amount of water required for sealing vacuum pumps may represent a high fresh

1 water consumption within common industrial processes. For example, the total sealing  
2 water quantity that is used in the vacuum pumps of a paper mill may sum up to 5-10 m<sup>3</sup>  
3 per tonne of paper produced (54).

4 Those quality requirements that have been reported for sealing water are also  
5 comparatively listed in Table 1 (55). The most restrictive parameter to consider is the  
6 proportion of abrasive matter content. In short, if solids are incorporated as water flows,  
7 they may cause premature seal failure and, ultimately, damage to the pumps.  
8 Temperature and salts content must be also carefully controlled, provided the precise  
9 role of sealing water is keeping the rotor system cool, and particularly considering that  
10 scaling is susceptible to occur inside the system.

11

## 12 **2.2 Process water**

13 The alternative use of reclaimed water in industrial processes mainly depends on its  
14 final application (Table 1). Electronic and pharmaceutical industrial processes, for  
15 example, require process water of almost distilled quality for some production  
16 applications. In fact, four different water quality standards are typically defined for  
17 pharmaceutical industrial use: potable water, purified water, highly purified water  
18 (HPW) and water for injections (WFI). In short, HPW requirements are shown in Table  
19 1 (56). In addition, food processing operations are a bit less restrictive, only requiring  
20 drinking water quality when there is direct process water contact with the products that  
21 are going to be consumed by people. On the other hand, leather-tanning industrial  
22 processes require relatively low-quality water use. Textile, pulp and paper, and metal  
23 industrial sectors usually demand intermediate requirements. The quality standards that  
24 are required for process water within those main industrial sectors using reclaimed  
25 water for their applications are considered next.

1

## 2 **2.2.1 Pulp and paper industry**

3 Fresh water is mainly used as dispersion and transport media for fibrous raw materials  
4 and additives along the production process developed in paper mills, from pulping to  
5 forming. In addition, water is also required as heat exchanging fluid, sealant in vacuum  
6 systems, lubricant agent, for the production of steam, and in high and low pressure  
7 showers (55-57).

8 At the beginning of the 20<sup>th</sup> century, water consumption in the pulp and paper  
9 sector was estimated to be over 600 m<sup>3</sup> per tonne of pulp produced. Nowadays,  
10 depending on the type of final paper product, raw material used, and the optimization of  
11 water use (including the installation of internal kidneys), modern paper mills just  
12 consume 4-100 m<sup>3</sup> per tonne (58-60). In short, Figure 2 shows maximum and minimum  
13 fresh water consumption values in modern paper mills manufacturing different types of  
14 paper (55). Actual consumption figures mainly depend on the water circuit optimization  
15 level that has been achieved within each paper mill.

16 Depending on the specific application where it is going to be used and the paper  
17 grade being produced, process water must meet certain chemical and physical criteria  
18 (Table 1) (61); which can be complemented by an even more restrictive set of values if  
19 recommended by industrial equipment suppliers. In short, the control of hardness and  
20 alkalinity is required to avoid the formation of calcium aggregates with organic colloids  
21 in the pulp suspension, and scaling in machinery and process circuits. In fact, the  
22 presence of colloidal material may produce losses in paper resistance and quality.  
23 Moreover, it could block showers, affecting the quality of the final product as well. In  
24 addition, some metals (Fe, Al, or Mn), chlorides, and sulphates, are highly corrosive;  
25 the latter may also produce scaling and odour problems (62-63).

1

## 2 **2.2.2 Textile industry**

3 The typical processing operations of the textile sector (e.g. washing, scouring, dyeing,  
4 printing, bleaching and finishing) require a great variety of water consumption  
5 thresholds. In short, it has been quantified that wool and felted fabrics processes are  
6 larger water consumers than other fabrics such as woven, knits, stock and carpet (Figure  
7 2) (64-68). Moreover, the amount of water used within the same fabric processing  
8 subcategory varies within a wide range depending on the achieved level of water circuit  
9 closure and the efficiency of the mill.

10 It would be pretty difficult defining a general quality standard for reclaimed water  
11 to be used within textile mills because water quality characteristics that are required  
12 within this industry are strongly linked to the type of fibre being processed (silk, cotton,  
13 polyester, etc.), the textile process itself (scouring, desizing, dyeing, washing, etc.), and  
14 the quality of the fabric produced. In general, turbidity and colour are undesirable for  
15 many textile purposes (Table 1) (5). Moreover, whether colour is produced by the  
16 presence of some organic compounds, it may exert demand for chlorine in the bleaching  
17 stage, and therefore reduce the effectiveness of chlorine as bleaching agent. In addition,  
18 suspended solids may also include organisms that could cause spots, or degradation of  
19 dressing and/or finishing solutions (66).

20 Furthermore, iron salts could be harmful to textile processing in many ways (69).  
21 In scouring and bleaching stages, they may provide yellow tinge to white material. In  
22 dyeing stages, iron may combine with some dyes and cause dulling effects. On the other  
23 hand, other metal ions may also act as catalysts in the decomposition of bleaching  
24 agents (70). Finally, hardness may cause deposits on textiles causing problems in those  
25 processes using soap (71, 72). All these basic parameters that must be monitored when

1 considering the use of reclaimed water in processes within textile industry are shown in  
2 Table 1 (5).

3

### 4 **2.2.3 Food industry**

5 Food processing plants need water for many purposes: washing and transporting raw  
6 materials and products, cleaning installations and equipments, thawing, canning,  
7 cooling, steam generation, etc. (73). Figure 3 shows a summary of the reported water  
8 consumption volumes for the majority of food, drink, and milk (FDM) sectors (74).  
9 Dairy sector particularly, followed by fish processing mills, and deodorization processes,  
10 account for those significant maximum water consumption figures.

11 As water may be in contact with food in some processes, the use of reclaimed  
12 water for food industrial applications may raise certain controversy in many countries.  
13 For example, the use of reclaimed water for food processing applications is currently  
14 forbidden under Spanish and Italian legislations (75-76). In general terms, the contact  
15 between food and reclaimed water is not allowed; as well as water quality must meet the  
16 standards of drinkable water in any other case. In this sense, the minimum drinking  
17 water requirements that are called for within the European Union are described in the  
18 Council Directive 98/83/EC (77), which defines water quality standards for human  
19 consumption. Correspondingly, all water contacting food should meet the standards set  
20 by their “*Drinking Water Guidelines*” in Australia (78); and there is a similar situation  
21 in the USA, where only potable water quality is allowed for cooking or being added to  
22 food products, as well as the quality of the final product must not be affected (i.e. water  
23 must be free of dissolved minerals that could make water excessively hard or affect taste  
24 somehow) (73, 79).

25

#### 1    **2.2.4 Electronic industry**

2    Electronic microchip manufacturing requires a large volume of ultrapure water (UPW);  
3    as this is the primary cleaning agent that is used in silicon wafer production processes  
4    (80). In short, UPW is mainly required for rinsing circuits, channels, and gates in order  
5    to remove chemicals that have been added along the manufacturing process. In fact,  
6    inorganic salts, and organic matter that may remain or be deposited on the wafer surface  
7    during processing, directly affect the number of usable devices that may be produced  
8    from a single silicon wafer (80); so rinsing with high purity water can therefore  
9    significantly increase electronic microchip production. Since water contacts wafer  
10   surface several times during manufacturing, its quality demand must be the highest.

11       For example, a typical 200 mm-wafer fabrication plant that produces 40,000 units  
12   per month uses as much water as 50,000 people would consume in a month (80). A  
13   survey developed in 2005 for Hsin-Chu Science-based Industrial Park (HSIP, Taiwan)  
14   showed that 0.79, 4.0, and 7.3 m<sup>3</sup> of water were necessary to produce one single 6-in, 8-  
15   in, and 12-in wafer, respectively (81). In addition, 0.2266 m<sup>3</sup> per wafer were reported to  
16   be required for the fabrication of one LED crystal; 0.025 m<sup>3</sup> per wafer were addressed  
17   for a single nickel-plated aluminium plate; and 0.94 L per set were necessary to produce  
18   a wireless card (81).

19       In general, the water quality standards that are demanded within the electronic  
20   industrial sector are discretionarily set by the owner of each production plant; and they  
21   are not specifically regulated by any public or private organism besides the existent  
22   general legislation in rule regarding health hazard and environmental concern in each  
23   country. Therefore, each manufacturing operation develops an internal quality  
24   specifications demand from its own processing requirements, or from sources of  
25   standards and general specifications such as the American Society for Testing and

1 Materials (ASTM), Semiconductor Equipment and Materials International (SEMI),  
2 Balazs Labs, or Sematech. Particularly, ASTM D5127-99 corresponds to the “*Standard*  
3 *Guide for Ultrapure Water Used in the Electronics and Semiconductor Industry*” (82).  
4 In short, general reference specifications for water quality within the electronic industry  
5 are collected in Table 1 as well (83).

6

### 7 **2.2.5 Chemical industry**

8 It has been recently reported that the chemical industry is consuming the 11% of  
9 the total water withdrawal in Europe (84), which approximately represents the 3% of the  
10 water directly abstracted by all industry (85). Nevertheless, the general trend is showing  
11 a significant reduction of these values; that is, the European Chemical Industry Council  
12 (CEFIC), for example, has reported that chemical industrial facilities have reduced their  
13 water consumption about an 8% from 2003 to 2007.

14 Water quality requirements and consumption figures widely differ among  
15 chemical industrial applications, provided this sector includes such a great diversity of  
16 manufactured products (e.g. basic chemicals, steel, fuel, petrochemicals, coal, other  
17 mining products, plastics, detergents and toiletries, medicines, paint, pesticides, etc.)  
18 For example, the total amount of water that is used in oil refineries has been estimated as  
19 0.25-0.34 m<sup>3</sup> of water per crude oil barrel (86); and extracting 1 barrel of bitumen from oil  
20 sand takes 2 to 3 barrels of water (87). In short, Table 1 also summarizes USEPA’s  
21 general guidelines for process water quality demands in the chemical industry, and the  
22 basic quality standards that are required in the petrochemical and coal sectors (88).

23

## 24 **3. MEMBRANE TECHNOLOGIES FOR WATER RECLAMATION**

25 Membrane filtration is basically based on placing a selective barrier between two phases.

1 As a result of exerting a driving force to one side of the membrane, components are  
2 transported towards the membrane surface. Therefore, some components pass through  
3 the membrane (permeate) and others are retained according to their size (retentate).  
4 Considering a particular industrial application, different membrane systems and  
5 configurations might be arranged, including pre-treatments and other treatment stages  
6 based upon different technologies, in order to meet those target water quality standards  
7 that this industrial application may specifically demand from reclaimed municipal  
8 wastewater.

9

### 10 **3.1. Types of membrane systems available for wastewater reclamation**

11 In general terms, membrane technologies may be classified according to the nature of  
12 the applied driving force (i.e. type of pressure or vacuum), or by the operating size  
13 ranges for filtration. In short: *microfiltration* (MF) can separate 0.1-10  $\mu\text{m}$  particles  
14 from solvents or other low-molecular components, for which an operating pressure of  
15 0.1-2 bar is required; *ultrafiltration* (UF) is applied to retain macromolecules or sub-  
16 micrometrical particles (0.002-0.1  $\mu\text{m}$ ), requiring operating pressures of 0.1-5 bar;  
17 *nanofiltration* (NF) is very useful for removing micro-pollutants, herbicides, and  
18 bivalent ions ( $\text{Ca}^{2+}$ ,  $\text{Mg}^{2+}$ ,  $\text{SO}_4^{2-}$ ,  $\text{CO}_3^{2-}$ ) due to its 0.5-2 nm pore-size filtration range,  
19 for which a 3-20 bar pressure is necessary; and *reverse osmosis* (RO) is able to separate  
20 macromolecules and low molecular mass compounds ( $>1\text{-}0.1\text{ nm}$ ), such as monovalent  
21 ions ( $\text{Na}^+$ ,  $\text{K}^+$ ,  $\text{Cl}^-$ ,  $\text{NO}_3^-$ , etc.) and sugars, working at higher pressure thresholds (5-120  
22 bar) in order to overcome higher osmotic pressure values in the solution (89).

23 A complete membrane treatment unit comprises membranes (in assembled  
24 modules), a pressure support structure, a feed inlet, a concentrate outlet, and an overall  
25 support structure. The main types of *membrane modules* that are used for wastewater

1 treatment are: *plate-and-frame*, *pleated cartridge*, *tubular*, *capillary*, *hollow fibre* and  
2 *spiral wound*. Each type of module shows specific advantages and disadvantages  
3 depending on feed water quality, their design, and maintenance protocols (90); whereas  
4 main differences among them are related to the allowed filtration area and their capacity  
5 to promote turbulence to reduce fouling occurrence.

6 In addition, manufacturers offer membrane modules made of a wide variety of  
7 materials (e.g. polypropylene, polysulfone, polyvinylidene difluoride, polyether-  
8 sulfone, cellulose acetate, aromatic polyamide, regenerated cellulose, titanium oxide,  
9 etc.) showing different physico-chemical behaviours (e.g. mechanical strength, oxidant  
10 tolerance, pH operating range, etc.). In short, their compatibility to each specific  
11 operational set of conditions should be verified by end-users (89-91).

12 The direction of feed-water flow in relation to the surface of the membrane  
13 determines the type of filtration in MF and UF systems. For example, an *encased*  
14 *membrane system* may use a *cross-flow design*, where part of the feed stream is  
15 withdrawn as permeate, whereas the other part is forced to flow across the membrane  
16 surface; or it may operate in *dead-end mode*, where the total feed water volume passes  
17 through the membrane, leaving all components that are larger than its pores in the feed's  
18 phase. This option results effective when the concentration of particles in the feed  
19 stream is low (turbidity <10 NTU), or the packing tendency of the filtered material does  
20 not produce large pressure drop across the membrane (90). On the other hand, water  
21 streams characterized by a higher concentration of particles or macromolecules (i.e. 10-  
22 100 NTU) will rapidly compact the cake if operated in dead-end mode, so an  
23 unacceptable quick pressure drop will be driven (92).

24 Similarly, semi-permeable membranes of NF and RO systems do not allow the  
25 passage of organics or salts, so dead-end filtration will result in plugging or fouling(90);

1 although NF filtration may be operated at both modes. In this sense, cross-flow systems  
2 are the best alternatives to keep stable filtration rates; despite they consume more  
3 energy because their pumping systems have to guarantee high superficial velocities (1-6  
4 m/s) through a constant recirculation loop (90, 93, 94).

5 Summing up, although any membrane design can be applied for wastewater with  
6 a low suspended solids content, only specifically designed membranes and operation  
7 modes would be able to handle effluents carrying high amounts of solids. Particularly,  
8 higher cross-flow velocities would be required in these cases. In short, it is highly  
9 recommended to perform optimization trials whenever a specific membrane filtration  
10 system is designed and implemented for reclaiming a specific wastewater quality.

11 Besides an encased design, membrane modules can be arranged conforming a  
12 *submerged membrane system* inside a tank containing wastewater, where filtration is  
13 performed by the application of vacuum. A lower sensitivity to fouling and a lower  
14 filtration pressure requirement are the main advantages of submerged systems; whereas  
15 some disadvantages can be also addressed, namely: i) foam episodes; ii) fouling may be  
16 boosted by high recovery rates, as a higher discharge frequency is required; iii) a higher  
17 potential health hazard as a consequence of the exposition of workers to wastewater  
18 contact; and iv) the operation of bubbling agitation (which facilitates filtration and  
19 reduces fouling) has to be balanced with its operational cost (4).

20 In addition, the direction and orientation of feed water across the surface of the  
21 membrane define inside-out and outside-in operation modes. Feed water surrounds the  
22 membrane in *outside-in* systems, so filtrate is collected inside the hollow fibre (lumen).  
23 In an *inside-out* system, feed water enters to the fibres at one end of the membrane  
24 element, and discharge stream passes through the element exiting at the opposite side.  
25 In this system, filtrated water is collected inside the element on the outside of the fibres.

1 In general, inside-out systems are more sensitive to fouling; therefore requiring more  
2 intense wastewater pre-treatment, and more frequent cleaning (95).

3 Finally, *membrane bioreactors* (MBRs) represent a particular configuration of  
4 submerged systems, where biological degradation of waste products is integrated with  
5 membrane filtration (96). As a consequence, the separation of solids does not depend on  
6 settling, and a smaller reactor volume is needed. In addition, they may be used with  
7 high filamentous bacteria contents and floating sludge, allowing a very long retention  
8 time for solids and generating much less sludge (96-99). In addition, MBR effluents are  
9 suitable for feeding RO polishing stages without installing additional pre-treatment  
10 processes in between. On the other hand, MBRs are relatively expensive to install and  
11 operate; as well as they address other limitations imposed by a low oxygen transfer  
12 efficiency (due to a high organic presence), pressure, temperature, and pH requirements  
13 (96-99).

14 There are two main MBR configurations: 1) *submerged membranes (S-MBR)*,  
15 where the filtration unit is integrated inside the bioreactor; and 2) *side-stream MBR*  
16 (external circulation), where a separate membrane module recycles the rejected stream  
17 back to the bioreactor. As permeate flux is relatively low in S-MBR configurations, it  
18 can be held for extended periods of time without decline; but membrane permeability  
19 could suffer rapid losses if solids content is high (>20 g/L), as well as an important  
20 membrane fouling may be generated at low mean cell residence times ( $\cong$  2 days) (98).  
21 On the other hand, both flux and fouling rates are much higher in side-stream MBRs; as  
22 well as they require more frequent, and rather more aggressive, cleaning operations,  
23 which can be properly performed backwashing or adding chemicals.

24 Summing up both operational and cost issues, it has been reported that submerged  
25 configurations operate more effectively than side-stream ones when they are applied to

1 reclaim domestic wastewater, considering both energy consumption and cleaning  
2 requirements (99). Specifically, aeration results to represent the main operating cost  
3 component of these systems because it is required for both mixing and transferring  
4 oxygen. In addition, S-MBRs operate at lower flux regimes requiring a greater  
5 membrane area, which also implies a greater associated investment. In particular, it has  
6 been demonstrated that a side-stream UF-MBR system fed with urban wastewater may  
7 produce reclaimed water of enough quality for municipal watering, toilet flushing, and  
8 car washing. Moreover, it could be also used for cooling; even as process water after  
9 softening (100).

10

### 11 **3.2. Challenges to improve the application of membrane filtration to reclaim** 12 **municipal wastewater**

13 Although membrane filtration generally produce high grade quality water requiring low  
14 footprint, and its implementation is nowadays following an increasing trend for  
15 municipal wastewater reclamation, they must also face some drawbacks and challenges  
16 for a future wider application.

17

#### 18 **3.2.1 Fouling and cleaning**

19 It is widely known that fouling is the main cause for membrane's loss of performance  
20 because it leads to flux decline, trans-membrane pressure increase, higher energy  
21 requirements, membrane biodegradation, and a greater salt passage rate (101, 102).  
22 Several types of membrane fouling have been identified, including those caused by  
23 suspended solids and particles, colloids, scaling, metal oxidation, organics, extracellular  
24 polymeric substances (EPS), and biological organisms (102-105) In fact, membranes

1 are usually affected by one or two different types of fouling at the same time, which are  
2 summarized in Table 2 (104, 106-109).

3 In general, *dissolved organic matter* (effluent organic matter, EfOM) typically  
4 present in municipal wastewater (TOC  $\approx$  5-20 mg/L; BOD<sub>5</sub>  $\approx$  3-10 mg/L) (110), is  
5 composed of a wide range of constituents (polysaccharides, proteins, aminosugars,  
6 nucleic acids, humic and fulvic acids, organic acids, EPS, and cell components).  
7 Together to other colloidal matter is able to partially pass (depending on the pore size)  
8 through MF or UF membranes causing important fouling to those subsequent NF or RO  
9 membranes that are disposed in serial (111). In particular, polysaccharides have been  
10 found to play the most important role in fouling NF and UF membranes (112); as well  
11 as the presence of soluble EPS (biomass supernatant) has been widely reported to play  
12 the main role in the formation of biofouling on MBR's membranes (109).

13 Although effluents from mWWTPs contain much lower total dissolved solids  
14 contents than seawater (1,500 versus 38,000 mg/L, respectively), *scaling* may also  
15 cause special trouble in RO membrane systems (113). Rivers, groundwater, rainfall,  
16 seawater, and municipal wastewater, contain basic or acidic inorganic species that are in  
17 equilibrium with precipitates, or with other potential scaling components, mainly: OH<sup>-</sup>,  
18 F<sup>-</sup>, CO<sub>3</sub><sup>2-</sup>, SO<sub>4</sub><sup>2-</sup>, PO<sub>4</sub><sup>3-</sup> and Si(OH)<sub>4</sub>; whereas cationic species that (directly or indirectly)  
19 are more likely to form precipitates in water include: Ca<sup>2+</sup>, Mg<sup>2+</sup>, Fe<sup>3+</sup> and Al<sup>3+</sup>. All  
20 these inorganic species are responsible to form those main precipitates (phosphates,  
21 sulphates, carbonates, hydroxides, and fluorides) that have been identified to cause  
22 scaling in reclaiming municipal wastewater RO systems (108).

23 Hydrophobicity, surface charge, pore size, and roughness, are *membrane*  
24 *properties* that have been related to greater fouling occurrence. In fact, it has been  
25 reported that if there are no crevices in the surface of the membrane, no material will be

1 deposited there because the boundary layer formation becomes less pronounced, and  
2 cross-flow will be then able to remove it at a faster rate than it could be deposited (114).

3 In addition, the effect of *membrane charge* is mainly reflected by its role in  
4 controlling electrostatic adsorption and pore clogging. Particles populating wastewater  
5 are generally negatively charged due to the presence of organic matter that came from  
6 every source of water that made it up (original drinking water, human activity, surface  
7 run-off, etc.), as well as from the bacterial activity that may have been developed along  
8 sewage transport (115, 116). Therefore, membranes showing a neutral to negative net  
9 surface charge tend to show hydrophilic interaction or electrostatic repulsion with these  
10 constituents, further reducing biofouling episodes (117, 118). Finally, other water  
11 quality properties, such as pH value or its ionic strength, may also influence organic  
12 matter deposition (119). For example, these compounds usually show carboxyl  
13 ( $-\text{COOH}$ ) or phenolic ( $-\text{OH}$ ) functional groups, which further increase the  
14 concentration of negative charges as the pH value turns higher (120).

15 The diversity of *materials* that may be used to manufacture commercial UF/MF  
16 membranes span the range from fully hydrophilic polymers (e.g. cellulose acetate, CA)  
17 to fully hydrophobic ones (e.g. polypropylene, PP; and polyethylene, PE). Between  
18 both well-defined groups of polymers, the polysulfone (PS) - polyethersulfone (PES)  
19 family, polyacrylonitrile (PAN), and polyvinylidene fluoride (PVDF) show an  
20 intermediate behaviour; and they may be blended with additives and pore formers in  
21 order to design moderate hydrophilic membranes (121). Particularly, sulfone (e.g. PS  
22 and PES) polymers are characterized by their mechanical strength, thermal and  
23 chemical stability, and excellent film forming properties; as well as their hydrophilic  
24 character, and their consequent *biofouling resistance* as well (122), may be easily

1 increased blending them with other polymers thanks to their high inherent solubility. As  
2 a result, they may even achieve CA membranes hydrophilicity figures (123-124).

3 Considering all these properties favouring or preventing membrane fouling, much  
4 research effort has been recently devoted to modify membrane surface properties in  
5 order to further enhance their *anti-fouling behaviour* (125-127). Particularly, a double  
6 repulsive NF hollow fiber membrane, with a positively charged selective layer and a  
7 negatively charged substrate, has recently been developed with the ability to effectively  
8 retain diverse dye molecules contained in textile industrial wastewater over a wide  
9 range of pH values (127).

10 Another common strategy to *control fouling* relies on installing aeration devices  
11 in MF, UF, or even in some NF, systems in order to enhance surface membrane shear  
12 and therefore reduce foulant layer thickness. Bubbling can be applied within membrane  
13 modules, or externally to them in submerged systems; its effectiveness has been  
14 reported to be the same (128). In contrast, aeration may represent the 70% of the total  
15 energy cost of the treatment, so current research efforts aim to optimize this operation  
16 and its associated cost figures. In fact, it has already been reported that only the 10% of  
17 the actual operational time is optimally devoted to perform this task (129). Finally,  
18 enhancing shear rate via mechanical means seems it would be a potential alternative to  
19 bubbling as a mean for fouling control, as it has been shown by magnetically induced  
20 membrane vibration in MBRs (130).

21 Furthermore, fouling can be classified as reversible or irreversible depending on  
22 the effectiveness of both, fouling controlling strategies and selected cleaning  
23 technologies. *Reversible fouling* can be described as the fraction that can be effectively  
24 removed by one or a combination of the following methods: 1) flow inversion  
25 (backwashing or permeate backflushing); 2) forward flush (cross-flow at high flow

1 rates); and 3) membrane surface scouring using relaxation breaks like it has been  
2 reported in MBR systems (131), or just bubbling air (128), among other alternatives.

3 In short, flux decline caused by irreversible fouling cannot be recovered unless  
4 membranes are cleaned by chemical agents, or ultimately replaced (90). Particularly, NF  
5 and RO membranes do not allow backwashing, so chemical treatment (namely the  
6 *clean-in-place* (CIP) operation) is the only feasible alternative for them (4, 90). The  
7 selection of those chemicals that are going to be used in CIP operation mainly depends  
8 on the type of foulant; although they generally belong to one of the following six  
9 categories: acids (e.g. HCl, HNO<sub>3</sub>, H<sub>2</sub>SO<sub>4</sub>, H<sub>3</sub>PO<sub>4</sub>, oxalic acid, and citric acid), caustics  
10 (e.g. NaOH, KOH, and NH<sub>4</sub>OH), sequestering complexes (e.g. EDTA), detergents (e.g.  
11 alkyl sulphate, and sodium dodecyl sulphate), enzymatic chemicals (e.g. alpha-CT, CP-  
12 T, and peroxidase), oxidizing disinfectants (e.g. NaOCl, H<sub>2</sub>O<sub>2</sub>, and KMnO<sub>4</sub>), and  
13 commercial blends (e.g. 4AquaClean, Divos, Triclean, and Ultrasil/AquaClean) (132,  
14 133).

15 In addition, cleaning effectiveness may be enhanced combining *physico-chemical*  
16 *cleaning* methods, which are those mechanical cleaning processes (i.e. backwashing)  
17 that are assisted by the addition of certain chemical agents (i.e. NaOCl or citric acid).  
18 For example, a chemically enhanced cleaning operation that is generally applied for  
19 cleaning MBRs daily consist on performing backwash using permeate to which certain  
20 chemical products have been added in small quantities (109).

21 Summing up, the selection of the best *cleaning strategy* (type of chemical,  
22 cleaning conditions, and frequency) for backwashes and CIP is the key to achieve both,  
23 a constant membrane system performance, and the lowest possible contribution to  
24 operational cost (4, 134). While mechanical cleaning is directly related to the  
25 operational cost of membrane treatment because energy consumption is mainly derived

1 from air supply; CIP step shows certain controversy because it requires long operation  
2 time, chemicals are consumed, and some membranes may be degraded (135, 136); as  
3 well as it may cause corrosion in the system, and it could result harmful to the  
4 environment when waste streams are discharged (137).

5 Current research on this topic focuses enhancing cleaning efficiency and reducing  
6 all the above mentioned drawbacks. Particularly, an “*enhanced flux maintenance*”  
7 (EFM) strategy has been recently postulated advantageous versus traditional CIP  
8 operation (138). In short, EFM firstly consists on flushing/soaking, or recirculating, the  
9 chemical solution to the membrane for a short period of time. The chemical solution is  
10 thereafter drained, and the membrane is ultimately flushed with feed water. As a result,  
11 an automated EFM strategy only requires 30-40 min to be completed, whereas CIP  
12 typically lasts several hours. Savings up about the 30% in the lifetime cost of membrane  
13 systems, as well as a 20% smaller footprint (a lower number of membranes is required),  
14 have already been reported for EFM (138).

15 Although an *enzymatic cleaning* is especially effective for protein-fouled  
16 membranes, and despite it is considered environmentally friendly, its associated cost is  
17 still prohibitive for large-scale applications; so *chemical-free cleaning strategies*  
18 (mechanical, mainly) are taking competitive advantage nowadays. Particularly, a new  
19 concept of *mechanical cleaning* (without chemicals) has been recently developed in  
20 MBR systems based on the use of a granular material that is introduced inside the  
21 membrane tank holding activated sludge. The operation mode consists on performing a  
22 constant filtration, without backwash and relaxation, where the granules touch or beat  
23 the surface of the membranes; therefore producing the desired cleaning effect (139).  
24 Moreover, it was confirmed that this application enhanced fluxes about a 20%, whereas  
25 the presence of the granules did not have a negative impact on the behaviour of the

1 membrane (140). In addition, it has also recently been demonstrated that prepared *inert*  
2 *salt solutions* (e.g. NaCl, NaNO<sub>3</sub>, Na<sub>2</sub>SO<sub>4</sub>, KCl, CsCl, and NH<sub>4</sub>Cl), seawater, or brines  
3 from desalination plants, can be used as effective cleaning agents for organic fouling in  
4 RO systems because they are able to react with foulants through ion-exchange processes  
5 (141).

6 Furthermore, *sonication* cleaning protocols have ultimately been assessed in both  
7 MBRs (109) and NF systems (142). In short, this process is essentially based on  
8 breaking the fouling cake down into smaller fragments. However, it may not be  
9 effective for those fouling types causing blockage of the pores. Nevertheless, its  
10 combination with other cleaning processes may surely lead to achieve higher flux  
11 recovery figures. Finally, the application of *shear-enhanced filtration systems* has been  
12 also assessed as an alternative membrane cleaning process. Particularly, the use of a  
13 *magnetically induce membrane vibration system* has been reported to achieve promising  
14 results at lab-scale MBRs (130).

15

### 16 **3.2.2 The management of rejects**

17 Another significant problem that arises when operating membrane processes (NF and  
18 RO systems, mainly) for water reclamation in mWWTPs is the production of a  
19 concentrated stream (or brine) that is characterized by a high concentration of  
20 micropollutants, including: organic matter, refractory chemicals (e.g. pesticides,  
21 personal care products, and endocrine disruptors), residuals from wastewater treatment  
22 itself (e.g. soluble microbial products, partially biodegraded organics, and anti-scaling  
23 chemicals), and biological materials (e.g. bacteria, viruses, oocysts, and cell fragments)  
24 (143). These substances can negatively affect the environment if they are freely  
25 disposed without appropriate treatment (144). Whether UF and MF systems also

1 produce rejected streams, they are not constantly being generated along operation; they  
2 are tightly linked to backwash frequency.

3 Although the diversity of harmful compounds that are contained within these  
4 rejected streams is pretty well-known, discharging them to surface water, oceans, and  
5 groundwater (depending on availability), has mainly been used as their predominant  
6 management alternative (145, 146). Halophyte irrigation has also been considered (144),  
7 but only when the original water source is not wastewater. Therefore, the development  
8 of alternative technologies that may allow recycling and reusing municipal wastewater  
9 within industrial processes, or in other applications, is highly encouraged under a more  
10 environmentally-friendly wastewater management perspective.

11 Different initiatives regarding the removal of hazardous components from  
12 concentrated streams have been reported to date in order to increase their quality  
13 standard before disposal. For example, advanced oxidation processes (AOPs), such as  
14 ozonation (147-149), Fenton processes, and UV/TiO<sub>2</sub> (150), have been demonstrated to  
15 be very efficient in the oxidation of a wide variety of pollutants typically present in  
16 retentated streams; as well as they may result even more efficient if a biodegradation  
17 stage is thereafter implemented (150).

18 In addition, electrolysis, followed by oxidation with hypochlorite, resulted  
19 successful to remove total ammonia nitrogen, COD, and colour, from RO concentrated  
20 effluents flowing out a mixed domestic and textile wastewater treatment plant (1519).  
21 Furthermore, denitrification has also successfully been reported using a bioactive  
22 fluidized bed adsorber reactor (152).

23 Biological methods (e.g. single sequential batch reactor and sequential anaerobic-  
24 aerobic two-sludge system) have been also reported capable to decolorize and reduce

1 COD values of the retentate produced by NF membranes used to polish textile effluents,  
2 for example (153).

3 Particularly, both, adsorption onto granular ferric hydroxide, and chemical  
4 precipitation with NaOH, were reported to be effective removing phosphate from NF  
5 concentrate (154). In addition, phosphate removal has been also assessed using  
6 polymeric ligand exchange resins that are able to recover phosphate forming struvite  
7 ( $\text{MgNH}_4\text{PO}_4 \cdot 6\text{H}_2\text{O}$ ), which may be finally used as a fertilizer (155).

8 Nevertheless, none of these treatments would totally solve the problem. Although  
9 some compounds are removed, others equally dangerous remain, especially when the  
10 original stream is sewage. For example, evaporating retentate in ponds requires a large  
11 surface and, although the installation of multi-effect evaporators reduces footprint, it  
12 could finally result very expensive (156).

13 In short, the best management alternative for these streams would be finding  
14 direct applications for them, namely recycle them. For example, the successful use of  
15 membrane filtration retentate from a paper mill effluent for brick manufacturing has  
16 been recently reported (157). Finally, some preliminary studies have demonstrated that  
17 bipolar membrane electrodialysis and electrochlorination are suitable treatments for  
18 generating mixed acid and base streams, and some chlorine generation, respectively;  
19 which can be directly applied to RO systems, as well as in other upstream pre-  
20 treatments (158).

21

#### 22 **4. WORLDWIDE DISTRIBUTION OF FACILITIES RECLAIMING MUNICIPAL** 23 **WASTEWATER FOR INDUSTRIAL APPLICATIONS**

24 Freshwater scarcity for human consumption and agricultural purposes may be  
25 significantly reduced in the close future as current freshwater intake would be

1 substituted by reclaimed municipal wastewater within those main industrial sectors  
2 which water quality requirements have previously been reviewed. Nevertheless, the  
3 number of facilities that nowadays supply municipal reclaimed sewage for industrial  
4 applications worldwide is still low (Figure 4) compared to the amount of them dedicated  
5 to produce reclaimed water for agriculture or urban purposes (10). In addition,  
6 important differences could be observed among different countries, continents even.

7 For example, reclaimed water is becoming of great importance in *Australia*,  
8 where legislation and standards impose that a minimum water use of the 20% should be  
9 supplied by reused water by 2012 (159). This requirement has represented a real driving  
10 force for industries and municipalities, encouraging them to actively develop research  
11 on water reuse and recycling. All municipal facilities serving reclaimed water for  
12 industrial purposes that have been found located in this country are based on multi-  
13 barrier membrane systems, namely MF/UF+RO (Table 3), and are mainly concentrated  
14 in the seaside area of Queensland and New South Wales (160-165). Only one membrane  
15 installation was found in Western Australia, Perth specifically (Figure 4). Sewage  
16 reclamation is not well extended yet in this area maybe because it has the highest  
17 amount of distributed water ( $\approx 30\%$ ) originated from groundwater resources (166), and  
18 their increased water demand has mainly been afforded by desalination facilities (167).

19 Two main water reclamation cores for industrial application can be clearly  
20 distinguished in *Asia*, namely *Singapore and China* (Figure 4 and Table 4). In order to  
21 reduce the amount of freshwater being imported from Malaysia, the government of  
22 *Singapore* has strongly promoted water reclamation projects. As a result, Singapore is  
23 the world's current leader implementing wastewater reclamation plants, including the  
24 creation of the first NEWater facilities in 2003, *Bedok* and *Kranji* plants (23- 168).  
25 NEWater is the brand name given to reclaimed water being produced by the

1 Singapore's Public Utilities Board (PUB). This reclaimed water has undergone very  
2 stringent purification and treatment processes using advanced dual-membrane systems  
3 (MF/RO or UF/RO) and ultraviolet disinfection technologies (Table 4). NEWater  
4 represents the 30% of Singapore's total water supply nowadays (169), in part because it  
5 has been demonstrated that NEWater costs half the price for desalinated water (170-  
6 171). Seven wastewater reclamation facilities have currently been located in Singapore  
7 (Figure 4); five of them producing NEWater (Table 4), which is not only used as  
8 process water for industrial purposes, but also serves as drinking water.

9 Wastewater reclamation is also especially important in North-Eastern *China*  
10 (Figure 4), where severe water shortage is emerging as a result of both a large  
11 population demand and increasing water pollution levels (172). However, municipal  
12 wastewater reclamation still needs a wider development within this country in order to  
13 increase its recycle rate (water recycled/water discharged) from the 2.7% achieved in  
14 2007 up to the aimed 20% in 2015 (173). These figures particularly contrast Israel's  
15 75% water recycling rate (174). Nevertheless, China's 11<sup>th</sup> five-year plan (2006-2010)  
16 clearly aimed to improve water reclamation infrastructure by awarding new projects and  
17 upgrading facilities that were already in operation (175). As a result, most water  
18 reclamation facilities that have been found located in China (Figure 4) were started-up  
19 during this period of time (176); and those implementing membrane filtration are the  
20 same in number, although their capacity is lower, than those applying other treatments  
21 based on the "*California Title 22*" (24, 176).

22 *Europe* locates just a few municipal wastewater reclamation facilities devoted to  
23 supply reclaimed water for industrial applications (Figure 4). In addition, all of them are  
24 of small capacity (Table 5); and main reuse projects in the Mediterranean region are  
25 related to agricultural, landscape irrigation, or groundwater recharge requirements (177).

1 Particularly, those plants located in Peterborough (UK) and Madrid (Spain) are based on  
2 multi-barrier membrane systems. The first one (MF+RO) started up in 2002, and it  
3 produces 1,200 m<sup>3</sup>/day of permeate for steam generation at Peterborough's Power  
4 Station (178). Madrid's one (UF+RO) is currently being built inside "*Cuenca Media-*  
5 *Alta de Arroyo Culebro*" mWWTP, and it will provide more than 10,000 m<sup>3</sup>/day of  
6 reclaimed water to Holmen Paper Company, which will become the first paper mill in  
7 Europe producing 100% recovered paper from 100% reclaimed water (4). In addition,  
8 plants located in Florence (Italy) and Villefranque (France) rely on MBR technology  
9 (179-180); whereas UF membranes were installed in Turin (Italy) and Katowice  
10 (Poland) (180-181).

11 All water reclamation projects that have been found within the African continent  
12 are located in *South Africa* (Figure 4), and all of them reclaim municipal wastewater for  
13 pulp and paper mills; although treatment characteristics are only available for Durban's  
14 water reclamation plant, which supplies 47,000 m<sup>3</sup>/day of tertiary treated water  
15 (sedimentation + ozonation + activated carbon filtration + chlorination) to *Mondi Paper*  
16 *Mill* (182).

17 Finally, the USA gather most of the municipal wastewater reclamation projects  
18 aiming to supply process water to industrial applications that were found in America;  
19 whereas only two were found in Mexico, and another one in Canada. None were found  
20 located in Central and South America (Figure 4). Among them, there are two well  
21 differentiated types of facilities: a) those based on membrane technologies; and b) those  
22 consisting on tertiary treatments based on "*Californian Title 22*" recommendations or  
23 slight modifications of them. The main difference between both treatment schedules is  
24 whether the main objective is obtaining water just for cooling use, or if higher water  
25 quality standards are required, for which multi-barrier membranes systems would be

1 installed (Table 6). In short, most plants located from Florida to Massachusetts produce  
2 make-up water for cooling operations through conventional tertiary treatments; whereas  
3 membrane filtration is preferred in those plants located from Middle to West USA  
4 (California and Arizona, mainly), and they are generally of bigger capacity. This may be  
5 expected provided California pioneered water reclamation initiatives creating Title 22  
6 quality guidelines, and starting-up the first municipal facility using RO systems for  
7 water reclamation in 1977 (183).

8

## 9 **5. GENERAL OVERVIEW AND DISCUSSION CONSIDERING ACTUAL** 10 **FACILITIES RECLAIMING WATER WORLDWIDE**

11 Conventional tertiary treatment (typically, flocculation + clarification + filtration +  
12 disinfection) is usually applied when reclaimed water would just be used for cooling  
13 applications; whereas membrane filtration is further required for the production of  
14 boiler make-up water at least, or when reclaimed water is going to be used within the  
15 process (Tables 3-6). Most of the facilities that use membrane systems to reclaim  
16 sewage rely on the combination of MF or UF with RO; and less are based on MBRs.

17 Although there were approximately 3,000 MBRs operating worldwide in 2008,  
18 the number of facilities that are nowadays applying this technology to reclaim  
19 municipal wastewater for industrial applications is still very low (Tables 3-6); although  
20 it is progressively increasing, and several pilot trials have been carried out to  
21 demonstrate the feasibility of combining MBR+RO technologies in new water  
22 reclamation projects (184-186).

23 Regarding NF treatment, it has been successfully used for reducing hardness,  
24 color and high organic content in feed water, at the same time that it represents an  
25 effective barrier for cysts and viruses (187). In comparison to RO, NF works at a lower

1 operating pressure and at a higher permeate flux; but it only achieves partial  
2 nitrites/nitrates reduction (188), it reaches lower salts rejection results (e.g. 78% in NF  
3 versus 95% in RO), and COD would not totally be removed (189). Even considering  
4 RO treatment superiority, actual NF application to filtrate secondary effluents of  
5 municipal wastewaters is still very limited (190-191). Nevertheless, some good essays  
6 considering the implementation of NF technology to reclaim biologically treated  
7 wastewater from textile, and pulp and paper industries, have been reported to date (127,  
8 192-194). In short, NF may be considered a promising water reclamation alternative to  
9 RO filtration in order to reduce the cost of the treatment in those applications where NF  
10 limitations would not be limiting the accomplishment of those defined target water  
11 quality requirements.

12 In general, and regardless the type of membrane being used, membrane  
13 processes are widely extended for treating industrial effluents and recycle them back  
14 into the process. For example, there are twenty Indian dyeing mills that have already  
15 implemented zero liquid discharge systems to recycle their effluents and reduce fresh  
16 water consumption; and even though each one has implemented its own specific  
17 wastewater treatment system, all of them use RO technology as the final treatment stage  
18 (156). Other companies within the textile industry, or other mills belonging to other  
19 industrial sectors, provide other good application alternatives. In short, it may be: an  
20 MBR treating bleaching water of cotton raw material (156); a combined UF+NF  
21 membrane system reducing freshwater use to its maximum extent in a mill producing  
22 fine and magazine quality papers (194-195); an MBR followed by an RO stage  
23 generating boiler feed water from a frozen-vegetables processing plant effluent (1); or  
24 an UF+RO membrane system implemented in order to satisfy boiler make-up water

1 demand in a power plant (196). They all succeeded in recycling effluents inside their  
2 industrial processes keeping a competitive product fabrication cost.

3         Nevertheless, it is also very important to highlight one more the fact that using  
4 drinkable water quality in some industrial applications would not be necessary (e.g.  
5 cooling, or sealing applications). For example, some paper mills use clarified water  
6 from dissolved air flotation units for this purpose (197); and evaporator and boiler  
7 condensed streams can also be used as pump sealing water (198). In addition, other  
8 mills and facilities have reported the use of municipal tertiary treated effluent  
9 (biological oxidation + alum coagulation + filtration + disinfection) (199). In short,  
10 water and energy savings may turn crucial in the future against a higher water scarcity  
11 threshold that would be imposed under the foreseen climate change. On the other hand,  
12 even though it would not always be required to generate water of drinkable grade for  
13 many industrial applications, the inherent health hazard that is attributed to municipal  
14 sewage management will always be a major concern.

15         Industrial effluent recycling is probably the most extended option used to reduce  
16 freshwater consumption because the facilities are generally located far away from  
17 mWWTPs; and wastewater transport to a mill may not result economically feasible.  
18 Besides, municipal wastewater reclamation usually faces a general population  
19 disapproval, sometimes even for irrigation purposes (200), due to the presence of micro-  
20 pollutants (i.e. natural and synthetic hormones, pesticides, pharmaceuticals or personal  
21 care products), and microorganisms meaning potential health hazard. In short, final  
22 reclaimed water quality is always suspicious of carrying undesired hazards. As a  
23 consequence, many surveys have been performed in order to guess which would be the  
24 potential public willingness to use reclaimed sewage (201-202). Its main conclusion  
25 stated that the best way for promoting its acceptance is providing factual information

1 regarding the production process, rather than launching persuasive campaigns.  
2 Moreover, in the same way people are nowadays concerned about plastic, glass, and  
3 paper recycling, the society should work on achieving the same concern for water use  
4 (industrial water use, particularly).

5         Summing up, Table 7 shows a summary of the general treatment removal  
6 efficiencies that are achieved for those main water quality parameters (e.g. TSS, TDS,  
7 COD, BOD<sub>5</sub>, TOC, inorganic concentrations, biological contents, etc.) after applying  
8 different technological alternatives to reclaim municipal wastewater (4, 203). In short,  
9 Table 7 provide a first approximation to an appropriate reclamation treatment selection  
10 chart considering average municipal wastewater quality figures, and the requirements  
11 that should be considered for a specific industrial application, which were previously  
12 reviewed.

13

#### 14 **4. CONCLUSIONS**

15 Environmental sustainability may be significantly enhanced reclaiming municipal  
16 wastewater. Particularly, it enables the replacement of fresh water use for industrial  
17 purposes in areas suffering water scarcity.

18         Depending on the type of industry, and on the specific application where  
19 reclaimed water is going to be used, water quality requirements that should be fulfilled  
20 are variable, so the implementation of those suitable reclamation technologies must be  
21 timely designed. The most important challenges that reclaimed facilities using  
22 membrane technologies must face are fouling and the management of the generated  
23 rejected streams.

24         The number of facilities that reclaim urban wastewater for different industrial  
25 applications has recently increased very quickly. Most of them rely on the use of multi-

1 barrier membranes systems consisting of MF, UF or MBR units followed by RO  
2 systems, which are able to produce water of a very high quality (drinkable grade).

3 Screening worldwide mWWTPs relaying on the use of membrane systems for  
4 producing reclaimed water for industrial applications, it has been found that 19  
5 membrane filtration-based facilities over a total 28 water reclamation plants are  
6 currently located in Asia (6 of them placed in Singapore); 15 of 45 in America, 9 of 10  
7 in Australia, and 4 of 6 in Europe. Only four plants, all of them related to paper mills,  
8 were found reported in South Africa, but it could not be verified whether they apply  
9 membrane technologies. No sewage reclamation facilities were currently found located  
10 in Central and South America.

11

## 12 **ACKNOWLEDGEMENTS**

13 This review has been developed within the framework of the following projects:  
14 “PROLIPAPEL” (S-0505/AMB-0100), funded by the Regional Government of Madrid  
15 (Comunidad Autónoma de Madrid), Spain; “AGUA Y ENERGÍA” (CTM2008-06886-  
16 C02-01), funded by the Ministry of Science and Innovation of Spain (Ministerio de  
17 Ciencia e Innovación); and “AQUAFIT4USE” (211534), funded by the European  
18 Union.

19

## 20 **REFERENCES**

- 21 1. Judd, S., and Jefferson, B. (2005) *Membranes for industrial wastewater recovery and*  
22 *re-use*; Elsevier Advanced Technology: Oxford, U.K.
- 23 2. Cabot C. (2007) *Climate change and water resources*. WaterAid; Environmental  
24 Resources Management: London, U.K.

- 1 3. Miranda, R., Blanco, A., and Negro, C. (2009) Accumulation of dissolved and  
2 colloidal material in papermaking-Application to simulation. *Chem. Eng. J.*, 148:  
3 385-393.
- 4 4. Ordóñez, R., Hermosilla, D., San Pío, I., and Blanco, A. (2011) Evaluation of MF and  
5 UF as pretreatments prior to RO applied to reclaim municipal wastewater for  
6 freshwater substitution in a paper mill: A practical experience. *Chem. Eng. J.*, 166:  
7 88-98.
- 8 5. WPCF (1989) *Water Reuse Manual of Practice SM-3* (2<sup>nd</sup> Ed.); Water Pollution  
9 Control Federation (WPCF): Alexandria, VA, U.S.A.
- 10 6. Toze, S. (2006) Reuse of effluent water-benefits and risks. *Agric. Water Manage.*, 80:  
11 147-159.
- 12 7. Solley, W.B., Pierce, R.R., and Perlman, H.A. (1998) *Circular 1200, Estimated use*  
13 *of water in the United States in 1995*; U.S. Geological Survey: Reston, VA, U.S.A.
- 14 8. Reardon, R., DiGiano, F., Aitken, M., Paranjape, S., Hwan Kim, J., and Shang, S.Y.  
15 (2006) *Membrane treatment of secondary effluents for subsequent use. WERF Report*  
16 *01-CTS-6*; Water Environment Research Foundation, International Water  
17 Association, IWA: Alexandria, VA, U.S.A.
- 18 9. Jiménez, B., and Asano, T. (2008) *Water Reuse: An International survey of current*  
19 *practice, issues and needs* (1<sup>st</sup> Ed.); IWA Publishing: London, UK.
- 20 10. Winpenny, J., Heinz, I., Koo-Oshima, S., Salgot, M., Collado, J., and Hernández, F.  
21 (2010). The wealth of waste. The economics of wastewater use in agriculture. *FAO*  
22 *Water Rep.*, 35; Food and Agriculture Organization of the United Nations: Rome,  
23 Italy.
- 24 11. Instituto Nacional de Estadística, INE (2008) Estadísticas e indicadores del agua.  
25 *Boletín informativo del instituto de estadística*, 1: 1-12.

- 1 12. Dirección General del Agua (2010) Plan Nacional de Reutilización de Aguas.  
2 Versión preliminar del plan; Ministerio de Medio Ambiente, y Medio Rural y  
3 Marino: Madrid, Spain.
- 4 13. Haruvy, N. (1997) Agricultural reuse of wastewater: nation -wide cost- benefit  
5 analysis. *Agric. Ecosyst. Environ.*, 66: 113-119.
- 6 14. Oron, G., Campos, C., Gillerman, L., and Salgot, M. (1999) Wastewater treatment,  
7 renovation and reuse for agricultural irrigation in small communities. *Agric. Water*  
8 *Manage.*, 38: 223-234.
- 9 15. Illueca-Muñoz, J., Mendoza-Roca, J.A., Iborra-Clara, A., Bes-Piá, A., Fajardo-  
10 Montañana, F., Martínez-Francisco, F.J., Bernácer-Bonora, I. (2008) Study of  
11 different alternatives of tertiary treatments for wastewater reclamation to optimize  
12 the water quality for irrigation reuse. *Desalination*, 222: 222–229.
- 13 16. Wong, J.M. (2000) Testing and implementation of an advanced wastewater  
14 reclamation and recycling system in a major petrochemical plant. *Water Sci.*  
15 *Technol.*, 42: 23-27.
- 16 17. Ciardelli, G., Corsi, L., and Marcucci, M. (2001) Testing and implementation of an  
17 advanced wastewater reclamation and recycling system in a major petrochemical  
18 plant. Membrane separation for wastewater reuse in the textile industry. *Resour.*  
19 *Conserv. Recycl.*, 31: 189-197.
- 20 18. Qin, J.J., Wai, M.N., Oo, M.H., and Wong, S.F. (2002) A feasibility study on the  
21 treatment and recycling of a wastewater from metal plating. *J. Membr. Sci.*, 208:  
22 213-221.
- 23 19. Rebhun, M., and Engel, G. (1988) Reuse of wastewater for industrial cooling  
24 systems. *J.-Water Pollut. Control Fed.*, 60: 237-241.

- 1 20. Van Tongeren, W., and Blanco, A. (2012) *AquaFit4Use. Bringing innovation to*  
2 *sustainable industrial water use in Europe. Final Brochure*; Seventh Framework  
3 Programme: European Union.
- 4 21. Miller, G.W. (2006) Integrated concepts in water reuse: managing global water  
5 needs. *Desalination*, 187: 65-75.
- 6 22. Bixio, D., Thoeye, C., Wintgens, T., Ravazzani, A., Miska, V., Muston, M.,  
7 Chikurel, H., Aharoni, A., Joksimovic, D., and Melin, A. (2008) Water reclamation  
8 and reuse: implementation and management issues. *Desalination*, 218: 13-23.
- 9 23. Thompson, M., and Powell, D. (2003) *Case study - Kranji high grade water*  
10 *reclamation plant, Singapore*; International Membrane Science and Technology  
11 Conference (IMSTEC), University of New South Wales, Sydney, Australia.
- 12 24. *California Code of Regulations, Title 22, Division 4. Environmental Health* (1978,  
13 amended in 1998); Office of Administrative Law, OAL: Sacramento, CA, U.S.A.
- 14 25. US EPA and US AID (2004) *Guidelines for water reuse. EPA/625/R-04/108*; US  
15 Environmental Protection Agency (EPA) and US Agency for International  
16 Development (AID): Washington, D.C., U.S.A.
- 17 26. NRMMC, EPHC, and AHMC (2006) *Australian guidelines for water recycling:*  
18 *Managing health and environmental risks (Phase 1). Sewage effluent and greywater*;  
19 Natural Resource Management Ministerial Council (NRMMC), Environmental  
20 Protection and Heritage Council (EPHC), and Australian Health Ministers'  
21 Conference (AHMC), Australian Government: Canberra, Australia.
- 22 27. Power, K. (2010) Recycled water use in Australia: regulations, guidelines and  
23 validation requirements for a national approach. *Waterlines Rep. Ser.*, 26 (March);  
24 National Water Commission, Australian Government: Canberra, Australia.

- 1 28. Durham, B. (2009) *Water reuse-Potential future guidelines and standards: UK and*  
2 *Europe. Water Conservation*; Chartered Institution of Water and Environmental  
3 Management (CIWEM): London, U.K.
- 4 29. MED WWR WG (2007) *Mediterranean Wastewater Reuse Report*; Joint  
5 Mediterranean - EU Water Initiative (MED-EUWI), European Commission: Brussels,  
6 Belgium.
- 7 30. Aquarec Project (EVK1-CT-2002-00130) (2006) *Integrated concepts for reuse of*  
8 *upgraded wastewater. Final Project Report (22 April)*; WTH Aachen University -  
9 Chemical Engineering: Aachen, Germany.
- 10 31. Wintgens, T., Melin, T., Schaefer, A., Khan, S., Muston, M., Bixio, D., and Thoeye,  
11 C. (2005) The role of membrane processes in municipal wastewater reclamation and  
12 reuse. *Desalination*, 178: 1-11.
- 13 32. Bonn elye, V., Guey, L., and Del Castillo, J. (2008) UF/MF as RO pre-treatment: the  
14 real benefit. *Desalination*, 222: 59-65.
- 15 33. Pearce, G.K. (2008) UF/MF pre-treatment to RO in seawater and wastewater reuse  
16 applications: a comparison energy costs, *Desalination*, 222: 66-73.
- 17 34. Grobicki, A. (2008) *The future of water use in industry*; Global Ministerial Forum  
18 on Research for Health (November 17<sup>th</sup>-19<sup>th</sup>), World Health Organization, Council  
19 on Health Research for Development, the Global Forum for Health Research, the  
20 Government of Mali, UNESCO, and the World Bank: Bamako, Mali.
- 21 35. Hutson, S.S, Barber, N.L., Kenny, J.F., Linsey, K.S., Lumia, D.S., and Maupin,  
22 M.A. (2004) Estimated use of water in the United States in 2000. *USGS Circular*,  
23 1268 (March); U.S. Geological Survey: Denver, CO, U.S.A.

- 1 36. Freedman, P.L., and Wolfe, J.R. (2007) *Thermal electric power plant water uses;*  
2 *Improvements promote sustainability and increase profits*; Canadian-US Water  
3 Policy Workshop (October 2<sup>nd</sup>): Washington, D.C., U.S.A.
- 4 37. US EPA. (1992) *Guidelines for water reuse. EPA/625/R-92/004*; US Environmental  
5 Protection Agency (EPA): Washington, D.C., U.S.A.
- 6 38. US Department of Energy (2006) *Energy Demands on Water Resources. Report to*  
7 *Congress on the Interdependency of Energy and Water*; US Department of Energy:  
8 Washington, D.C., U.S.A.
- 9 39. Li H., Hsieh M.-K., Chien S.-H., Monnell J.D. Dzombak D.A., Vidic R.V. (2011)  
10 Control of mineral scale deposition in cooling systems using secondary-treated  
11 municipal wastewater. *Water Res.*, 45: 748-760.
- 12 40. Strmcnik, D., Gaberscek, M., Pihlar, B., Kocar, D., and Jamnik, J. (2009) Copper  
13 dissolution in ammonia solutions: identification of the mechanism at low  
14 overpotentials. *J. Electrochem. Soc.*, 156: 222-229.
- 15 41. Nishida, I., Shimada, Y., Saito, T., Okaue, Y., Yokoyama, T. (2009) Effect of  
16 aluminium on the deposition of silica scales in cooling water systems Original  
17 Research Article. *J. Colloid Interface Sci.*, 335: 18-23.
- 18 42. Butala, D., Goodrich, B.F., Amjad, Z., and Pugh, J. (1999) The Influence of  
19 Recirculating Water Impurities on the Performance of Calcium Phosphate Inhibiting  
20 Polymers, Conference Paper, Document ID99118. *Corrosion*, 99: 25-30.
- 21 43. Choudhary S.G. (1998) Emerging microbial control issues in cooling water systems.  
22 *Hydrocarbon Process.*, 77: 91-102.
- 23 44. Critchley M. and Betham R. (2006) *Protozoa in cooling towers: implications for*  
24 *public health a chemical control*; CSIRO Manufacturing and Materials Technology:  
25 Clayton, VIC, Australia.

- 1 45. ISO (1998) Water quality-detection and enumeration of *Legionella*. ISO  
2 11731:1998; International Organization for Standardization: Geneva, Switzerland.
- 3 46. US EPA (1999) *Legionella: Human health criteria document*. EPA-822-R-99-001;  
4 US Environmental Protection Agency (EPA): Washington, D.C., U.S.A.
- 5 47. CTI (2000) *Legionellosis. Guideline: Best practices for control of Legionella*;  
6 Cooling Technology Institute (CTI): Houston, TX, U.S.A.
- 7 48. SA Health (2008) *Public and Environmental Health (Legionella) Regulations*; SA  
8 Health, Government of South Australia: Adelaide, Australia.
- 9 49. ASTM International (2008) *Standard guide for inspecting water systems for*  
10 *Legionella and investigation possible outbreaks of Legionellosis*. ASTM D5952-08;  
11 ASTM International: West Conshohocken, PA, U.S.A.
- 12 50. Melo L.F. and Bott T.R. (1997) Biofouling in water systems. *Exp. Therm. Fluid Sci.*,  
13 14: 375–381
- 14 51. Flemming H.C. (2002) Biofouling in water systems-cases, causes and  
15 countermeasures. *Appl. Microbiol.*, 59: 629-640
- 16 52. The University of Melbourne (2012) *Cooling towers: Controlling the critical risks*  
17 *and operational programs*. *Health and Safety*; The University of Melbourne:  
18 Melbourne, Australia.
- 19 53. Frayne C. and Blake R. (2003) *The Metro handbook of water treatment for HVAC*  
20 *systems*; The Metro Group, Inc.: Long Island City, NY, U.S.A.
- 21 54. Peng, C.Y. (2006) *Water Consumption, quality demanded, and re-use of the treated*  
22 *wastewater for paper industry*; Water Industry Development and Promotion  
23 Association, WIDPA: Taipei, Taiwan.
- 24 55. Sundholm P. (2000) *Mill operations in production of main paper and board grades*.  
25 *In: Paulupuro H. (Editor) Papermaking science and technology. Book 8:*

- 1     *Papermaking, Part 1. Stock preparation and wet end* (1<sup>st</sup> Ed.); Gummerus Printing:  
2     Jyväskylä, Finland.
- 3     56. Ravikumar, K. (2008). *High purity water dominates the overall European*  
4     *pharmaceutical water markets*; Frost and Sullivan Publications: San Antonio, TX,  
5     U.S.A.
- 6     57. Negro, C., Blanco, A., Gaspar, I., and Tijero, J. (1995) El agua en la industria  
7     papelera. *Ingeniería Química*, 317: 137-147.
- 8     58. IPPC Bureau (2001) *Reference document on best available techniques in the pulp*  
9     *and paper industry*; Integrated Pollution Prevention and Control (IPPC) Bureau,  
10    European Commission, Joint Research Centre, Institute for Prospective  
11    Technological Studies: Seville, Spain.
- 12    59. Brongers, M.P.H., and Mierzwa, A.J. (2002) *Pulp and paper: summary and analysis*  
13    *of results, corrosion control and prevention, Appendix W. In: Koch GH, Brongers*  
14    *MPH, Thompson NG, Virmani YP, Payer JH (Editors) Corrosion cost and*  
15    *preventive strategies in the United States. FHWA-RD-01-156*; Federal Highway  
16    Administration, U.S. Department of Transportation: Washington D.C.
- 17    60. Blanco, A., Negro, C., Monte, C., Fuente, E., and Tijero J. (2004) The challenges of  
18    sustainable papermaking. *Environ. Sci. Technol.*, 38: 414-420.
- 19    61. Camp Dresser and McKee Inc. (1982) *Water recycling in the pulp and paper*  
20    *industry in California. Prepared for the California State Water Resources Control*  
21    *Board*; Office of Water Recycling: Sacramento, CA, January.
- 22    62. Hubbe, M.A. (2007a) Water and papermaking, 1. Fresh water components. *Paper*  
23    *Technol.*, 48: 18-24.
- 24    63. Hubbe, M.A. (2007b) Water and Papermaking, 2. White water components. *Paper*  
25    *Technol.*, 48: 31-40.

- 1 64. Smith, B. (1986) *Identification and reduction of pollution sources in textile wet*  
2 *processing*; North Carolina Department of Natural Resources and Community  
3 Development, Division of Pollution Prevention and Environmental Assistance:  
4 Raleigh, NC, U.S.A.
- 5 65. US EPA (1996) *Best management practices for pollution prevention in the textile*  
6 *industry*. EPA/625/R-96/004; US Environmental Protection Agency (EPA):  
7 Washington, D.C., U.S.A.
- 8 66. Mattioli, D., Malpei, F., Bortone, G., and Rozzi, A. (2002) *Water minimisation and*  
9 *reuse in the textile industry*. In: Lens P., Hulshoff L., Wilderer P., Asano T. (Editors)  
10 *Water recycling and resource recovery in industry, analysis, technologies and*  
11 *implementation*, pp. 472-487; IWA Publishing: London, U.K.
- 12 67. Van der Bruggen, B., Curcio, E., and Drioli, E. (2004) Process intensification in the  
13 textile industry: the role of membrane technology. *J. Environ. Manage.*, 73: 267-274.
- 14 68. Wenzel, H., and Knudesen, H.H. (2005) *Water savings and reuse in the textiles*  
15 *industry*. In Omelchenko, A., Pivovarov, A.A., Swindall, W.J. (Editors) *Modern*  
16 *tools and methods of water treatment for improving living standards*; Springer:  
17 Amsterdam, The Netherlands.
- 18 69. McPeak, J.F., and Aronovitch, H.L. (1983) *Iron in water and processes for its*  
19 *removal*; 21<sup>st</sup> Annual Liberty Bell Corrosion Course (September 22<sup>nd</sup>), NACE:  
20 Philadelphia, PA, U.S.A..
- 21 70. Bluhm, T., Bercovici, R., and Krussmann, H. (1995) Minimizing fabric damages in  
22 detergency caused by catalysts. *Tenside, Surfactants, Deterg.*, 32: 433-437.
- 23 71. Van der Bruggen, B., De Vreese, I., and Vandecasteele, C. (2001) Water  
24 reclamation in the textile industry: Nanofiltration of dye baths for wool dyeing. *Ind.*  
25 *Eng. Chem. Res.*, 40: 3973-3978.

- 1 72. CPCB (2007) *Advanced methods for treatment of textile industry effluents*; Central  
2 Pollution Control Board (CPCB), Ministry of Environment and Forest: New Dheli,  
3 India.
- 4 73. Flores, R.A., Powell, G.M., and Aramouni, F.M. (1997) *Water Supply for Food and*  
5 *Beverage Processing Operations. Publication MF-1122*; Cooperative Extension  
6 Service, Kansas State University: Manhattan, KS, U.S.A.
- 7 74. IPPC Bureau (2006) *Reference document on best available techniques in the food,*  
8 *drink and milk industry*; Integrated Pollution Prevention and Control (IPPC) Bureau.  
9 European Commission, Joint Research Centre, Institute for Prospective  
10 Technological Studies: Seville, Spain.
- 11 75. Ministero dell’Ambiente de della Tutela del Territorio (2003) *Decreto Ministeriale*  
12 *185/2003. Regolamento recante norme tecniche per il riutilizzo delle acque reflue*;  
13 Ministero dell’Ambiente de della Tutela del Territorio, Governo di Italia: Rome, .  
14 Italy.
- 15 76. Ministerio de la Presidencia (2007) *Real Decreto 1620/2007, por el que se establece*  
16 *el régimen jurídico de la reutilización de las aguas depuradas*; Ministerio de la  
17 Presidencia, Gobierno de España: Madrid, Spain.
- 18 77. EC (1998) *Council Directive 98/83/EC on the quality of water intended for human*  
19 *consumption*; European Commission (EC): Brussels, Belgium.
- 20 78. NHMRC and NRMCMC (2011) *Australian Drinking Water Guidelines 6. National*  
21 *Water Quality Management Strategy*; National Health and Medical Research Council  
22 (NHMRC), National Resource Management Ministerial Council (NRMCMC),  
23 Commonwealth of Australia: Canberra, Australia.

- 1 79. US EPA (2004) *Safe Drinking Water Act, 30<sup>th</sup> Anniversary: Understanding the Safe*  
2 *Drinking Water Act. EPA 816-F-04-030*; US Environmental Protection Agency  
3 (EPA): Washington, D.C., U.S.A.
- 4 80. Okazaki, M., Uraki, M., Miura, K., and Nishida, T. (2000) Water recycling using  
5 sequential membrane treatment in the electronics industry. *Desalination*, 131: 65-73.
- 6 81. Lin, W.S., Chen, C.H., Chang, P.L., Kin, K.T., Tseng, S.T., Lee, K.H., Chen, C.W.  
7 (2006) *Review of water use and water conservation technology in High-Tech*  
8 *Industry*; Taiwan Water Industry Conference (July 27<sup>th</sup>-28<sup>th</sup>) : Taipei, Taiwan.
- 9 82. ASTM International (1999) *Standard guide for ultra pure water used in the*  
10 *electronics and semiconductor industry. ASTM D5127-99*; ASTM International:  
11 West Conshohocken, PA, U.S.A.
- 12 83. Lens, P., Hulshoff, P., Wilderer, P., and Asano, T. (2002) *Water recycling and*  
13 *resource recovery in industry, analysis, technologies and implementation*; IWA  
14 Publishing: London, U.K.
- 15 84. EEA (2009) *Water resources across Europe-confronting water scarcity and drought.*  
16 *EEA Report 2*; European Environment Agency (EEA): Copenhagen, Denmark.
- 17 85. EA (2005) *Measuring environmental performance. Sector report for the chemical*  
18 *manufacturing industry*; The Environment Agency (EA): London, U. K.
- 19 86. Byers, W., Doerr, W., Krishnan, R., and Peters, D. (1995) *How to implement*  
20 *industrial water reuse. A systematic approach*; Center for Waste Reduction  
21 Technologies and American Institute of Chemical Engineers (AIChE): New York,  
22 NY, U.S.A.
- 23 87. Shell (2009) *Royal Dutch Shell PLC Sustainability Report*; The Shell Company: The  
24 Hague, the Netherlands.

- 1 88. Rommelmann, D.W., Duranceau, S.J., Stahl, M.W., Kamnikar, C., and Gonzales,  
2 R.M. (2004) *Industrial water quality requirements for reclaimed water*; American  
3 Water Works Association (AWWA) Research Foundation: Denver, CO, U.S.A.
- 4 89. Van der Bruggen, B., Vandecasteele, C., Van Gestel, T., Doyenb, W., and Leysenb,  
5 R., (2003) A review of pressure-driven membrane processes in wastewater treatment  
6 and drinking water production. *Environ. Prog.*, 22: 46-56.
- 7 90. Mallevialle, J., Odendaal, P.E., and Wiesner, M.R. (1999) *Water treatment*  
8 *membrane process*; McGraw Hill: New York, NY, U.S.A.
- 9 91. Sagle A., and Freeman B. (2004) *Fundamentals of Membranes for Water Treatment*  
10 *In: The Future of Desalination in Texas: Volume 2, Report Number 363*, pp. 137-  
11 154; Texas Water Development Board: Austin, TX, U.S.A.
- 12 92. Bates, W.T. (1999) *Capillary UF as RO pretreatment*; International Water  
13 Conference (October 22<sup>nd</sup>), Engineers' Society of Western Pennsylvania: Pittsburg,  
14 PA, U.S.A.
- 15 93. Parameshwaran, K., Fane, A.G., Cho, B.D., and Kim, K.J. (2001) Analysis of  
16 microfiltration performance with constant flux processing of secondary effluent.  
17 *Water Res.*, 35: 4349-4358.
- 18 94. Al-Malack, M.H., and Anderson, G.K. (1996) Coagulation-cross flow  
19 microfiltration of domestic wastewater. *J. Membr. Sci.*, 121: 59-70.
- 20 95. Cicek, N., Franco, J.P., Suidan, M.T., Urbain V. (1998) Using a membrane  
21 bioreactor to reclaim wastewater, *J. - Am. Water Works Assoc.*, 90: 105-113.
- 22 96. Judd, S. (2006) *The MBR book: principles and applications of membrane*  
23 *bioreactors in water and wastewater treatment*; Elsevier: Oxford, U.K.

- 1 97. Skouteris, G., Hermosilla, D., López, P., Negro, C., and Blanco, A. (2012)  
2 Anaerobic Membrane Bioreactors for Wastewater Treatment: a Review. *Chem. Eng.*  
3 *J.*, 198-199: 138-148.
- 4 98. Shane, R., Samer, P.E., and Rhodes, R. (2005) Process limits of municipal  
5 wastewater treatment with the submerged membrane bioreactor. *J. Environ. Eng.*,  
6 131: 410-416.
- 7 99. Gander, M., Jefferson, B., and Judd, S. (2000) Aerobic MBRs for domestic  
8 wastewater treatment: a review with cost considerations. *Sep. Purif. Technol.*, 18:  
9 119-130.
- 10 100. Xing, C.-H., Tardieu, E., Qian, Y., and Wen, X.H. (2000) Ultrafiltration membrane  
11 bioreactor for urban wastewater reclamation. *J. Membr. Sci.*, 177: 73-82.
- 12 101. Al-Ahmad, M., Aleem, F.A.A., Mutiri, A., and Ubaisy, A. (2000) Biofouling in  
13 RO membranes systems, Part 1: Fundamentals and control. *Desalination*, 132: 173-  
14 179.
- 15 102. Shirazi, S., Lin, C.J., and Chen, D. (2010) Inorganic fouling of pressure-driven  
16 membrane processes-A critical review. *Desalination*, 250: 236-248.
- 17 103. Corbett, B.E., Moody, C.D., and Morris, M.D. (2003) Evaluation of reverse  
18 osmosis scaling prevention devices at high recovery. *Advanced Water Treatment*  
19 *Program Report*, 91 (March); US Department of the Interior, Bureau of Reclamation:  
20 Denver, Colorado, USA.
- 21 104. Ning, R.Y., and Troyer, T.L. (2007) Colloidal fouling of RO membranes following  
22 MF/UF in the reclamation of municipal wastewater. *Desalination*, 208: 232-237.
- 23 105. Meng, F., Chae, S.R., Drews, A., Kraume, M., Shin, H.S. and Yang, F. (2009)  
24 Recent advances in membrane bioreactors (MBRs): Membrane fouling and  
25 membrane material. *Water Res.*, 43: 1489-1512.

- 1 106. Dudley, L.Y. (1997) *Membrane fouling and autopsy*. Membrane Fouling  
2 Symposium; Dutch Membrane & Filtration Society: Amsterdam, The Netherlands.
- 3 107. Vrouwenvelder, J.S., and Van der Kooij, D. (2001) Diagnosis, prediction and  
4 prevention of biofouling of NF and RO membranes. *Desalination*, 139: 65-71.
- 5 108. Xie, R.J., Gómez, R.J., Xing, Y.J., and Klose, P.S. (2004) Fouling assessment in a  
6 municipal water reclamation reverse osmosis system as related to concentration  
7 factor. *J. Environ. Eng. Sci.*, 3: 61-72.
- 8 109. Le-Clech, P., Chen, V., and Fane, T. (2006) Fouling in membrane bioreactors used  
9 in wastewater treatment. *J. Membr. Sci.*, 284: 17-53.
- 10 110. Bartels, C.R., Wilf, M., Andes, K., and Iong, J. (2005) Design considerations for  
11 wastewater treatment by reverse osmosis. *Water Sci. Technol.*, 51: 473-482.
- 12 111. Xu, P., Bellona, C., and Drewes, J.E. (2010) Fouling of nanofiltration and reverse  
13 osmosis membranes during municipal wastewater reclamation: Membrane autopsy  
14 results from pilot-scale investigations. *J. Membr. Sci.*, 353: 111-121.
- 15 112. Jarusutthirak, C., Amy, G., and Croué, J.P. (2002) Fouling characteristics of  
16 wastewater effluent organic matter isolates on NF and UF membranes. *Desalination*,  
17 145: 247-255.
- 18 113. Adham, S., and De Gagliardo, P. (1998) Membrane bioreactors for water  
19 repurification – Phase I. *Project 1425-97-FC-81-30006J. Desalination Research and*  
20 *Development Program Report*, 34 (November); US Department of the Interior,  
21 Bureau of Reclamation Technical Service Center: Denver, Colorado, USA.
- 22 114. Vrijenhoek, E.M., Hong, S., and Elimelech, M. (2001) Influence of membrane  
23 surface properties on initial rate of colloidal fouling of reverse osmosis and  
24 nanofiltration membranes. *J. Membr. Sci.*, 188: 115-128.

- 1 115. Bratby, J. (2006) *Coagulation and Flocculation in Water and Wastewater*  
2 *Treatment* (2<sup>nd</sup> Edition); IWA Publishing: London, UK.
- 3 116. Gregory, J. (2006). *Particles in Water, Properties and Processes*; IWA Publishing:  
4 London, UK.
- 5 117. Tu, S.C., Ravindran, V., Den, W., and Pirbazari, M. (2001) Predictive membrane  
6 transport model for nanofiltration processes in water treatment. *AIChE J.*, 6: 1346-  
7 1362.
- 8 118. Herzberg, M., Sweity, A., Brami, M., Kaufman, Y., Freger, V., Oron, G., Belfer, S.,  
9 and Kasher, R. (2011) Surface properties and reduced biofouling of graft-  
10 copolymers that possess oppositely charged groups. *Biomacromolecules*, 12: 1169-  
11 1177.
- 12 119. Braghetta, A., Di Giano, F.A., and Ball, W.P. (1997) Nanofiltration of natural  
13 organic matter: pH and ionic strength effects. *J. Environ. Eng. ASCE*, 123: 628-641.
- 14 120. Jones, K.L., and O'Melia, C.R. (2000) Protein and humic acid adsorption onto  
15 hydrophilic membrane surfaces: effects of pH and ionic strength. *J. Membr. Sci.*,  
16 165: 31-46.
- 17 121. Masuelli, M., Marchese, J., and Ochoa, N.A. (2009) SPC/PVDF membranes for  
18 emulsified oily wastewater treatment. *J. Membr. Sci.*, 326: 688-693.
- 19 122. Pearce G. (2007) Introduction to membranes: Membrane selection. *Filtr. & Sep.*,  
20 44: 35-37.
- 21 123. Susanto, H., Stahra, N., and Ulbricht, M. (2009) High performance polyether-  
22 sulfone microfiltration membranes having high flux and stable hydrophilic property.  
23 *J. Membr. Sci.*, 342: 153-164.

- 1 124. Reddy, A.V.R., and Patel, H.R. (2008) Chemically treated polyethersulfone/  
2 polyacrylonitrile blend ultrafiltration membranes for better fouling resistance.  
3 *Desalination*, 221: 318-323.
- 4 125. Hilal, N., Al-Khatib, L., Atkin, B.P., Kochkodan, V., and Potapchenko, N. (2003)  
5 Photochemical modification of membrane surfaces for (bio) fouling reduction: a  
6 nano-scale study using AFM. *Desalination*, 158: 65-72.
- 7 126. Liu, C.X., Zhang, D.R., Yi, H., Zhao, X.S., and Bai, R. (2010) Modification of  
8 membrane surface for anti-biofouling performance: Effect of anti-adhesion and anti-  
9 bacteria approaches. *J. Membr. Sci.*, 346: 121-130.
- 10 127. Sun, S.P., Hatton, T.A., Chan, S.Y., Chung, T.S. (2012) Novel thin-film composite  
11 nanofiltration hollow fiber membranes with double repulsion for effective removal of  
12 emerging organic matters from water. *J. Membr. Sci.*, 401-402: 152-162.
- 13 128. Cui, Z.F., Chang, S., and Fane, A.G. (2003) The use of gas bubbling to enhance  
14 membrane processes. *J. Membr. Sci.*, 221: 1-35.
- 15 129. Drews, A. (2010) Membrane fouling in membrane bioreactors-Characterisation,  
16 contradictions, cause and cures. *J. Membr. Sci.*, 363: 1-28
- 17 130. Bilad, M.R., Mezohegyi, G., Declerck, P., and Vankelecom, I.F.J. (2012) Novel  
18 magnetically induced membrane vibration (MMV) for fouling control in membrane  
19 bioreactors. *Water Res.*, 46: 63-72.
- 20 131. Radjenovic, J., Matosic, M., Mijatovi, I., Petrovic, M., and Barceló, D. (2008)  
21 Membrane bioreactor (MBR) as an advanced wastewater treatment technology.  
22 *Handb. Env. Chem.*, 5: 37-101.
- 23 132. Madaeni, S.S., and Samieirad, S. (2010) Chemical cleaning of reverse osmosis  
24 membrane fouled by wastewater. *Desalination*, 257: 80-86.

- 1 133. Zondervan, E., and Roffel, B. (2007) Evaluation of different cleaning agents used  
2 for cleaning ultrafiltration membranes fouled by surface water. *J. Membr. Sci.*, 304:  
3 40-49.
- 4 134. Brepols, C., Drensla, K., Janot, A., Trimborn, M., and Engelhardt N. (2008)  
5 Strategies for chemical cleaning in large scale membrane bioreactors. *Water Sci.*  
6 *Technol.*, 57: 457-463.
- 7 135. Bohner, H.F., and Bradley, R.L. (1992) Effective cleaning and sanitizing of  
8 polysulfone ultrafiltration membrane systems. *J. Dairy Sci.*, 75: 718-724.
- 9 136. Wang, P., Wang, Z., Wu, Z., Zhou, Q., and Yang, D. (2010) Effect of hypochlorite  
10 cleaning on the physiochemical characteristics of polyvinylidene fluoride membranes.  
11 *Chem. Eng. J.*, 162: 1050-1056.
- 12 137. Jeppesen, T., Shu, L., Keir, G., and Jegatheesan, V. (2009) Metal recovery from  
13 reverse osmosis concentrate. *J. Clean Prod.*, 17:703-707.
- 14 138. Caothien, S., Charles, L., and O'Connell, P. (2003) *Reducing fouling and the cost*  
15 *of membrane systems*. AWWA MTC57566; American Water Works Association  
16 (AWWA): Denver, CO, U.S.A.
- 17 139. Krause, S., Tournier, R., Cornel, P., and Siembida, B. (2008) *Granulate- driven*  
18 *fouling control in a submerged membrane module for MBR application*; 6<sup>th</sup> IWA's  
19 World Water Congress and Exhibition: Vienna, Austria (September 8<sup>th</sup>-9<sup>th</sup>) .
- 20 140. Siembida, B., Cornel, P., Krause, S., and Zimmermann, B. (2010) Effect of  
21 mechanical cleaning with granular material on the permeability of submerged  
22 membranes in the MBR process. *Water Res.*, 44: 4037-4046.
- 23 141. Lee, S., and Elimelech, M. (2007) Salt cleaning of organic-fouled reverse osmosis  
24 membranes. *Water Res.*, 41: 1134-1142.

- 1 142. Al-Amoudi, A., and Lovitt R.W. (2007) Fouling strategies and the cleaning system  
2 of NF membranes and factors affecting cleaning efficiency. *J Membrane Science*  
3 303: 4-28.
- 4 143. Westerhoff, P., Moon, H., Minakata, D., and Crittenden, J. (2009) Oxidation of  
5 organics in retentates from reverse osmosis wastewater reuse facilities water. *Water*  
6 *Res.*, 43: 3992-3998.
- 7 144. Riley, J.J., Fitzsimmons, K.M., and Glenn, E.P. (1997) Halophyte irrigation: an  
8 overlooked strategy for management of membrane filtration concentrate.  
9 *Desalination*, 110: 197-211.
- 10 145. Mickley, M., Hamilton, R., Gallegos, L., and Truesdall, J. (1993) *Membrane*  
11 *concentration disposal*; American Water Works Association (AWWA) Research  
12 Foundation: Denver, CO, U.S.A.
- 13 146. Nederlof, M.M., van Paassen, J.A.M., and Jong, R. (2005) Nanofiltration  
14 concentrate disposal: experiences in The Netherlands. *Desalination*, 178: 303-312.
- 15 147. Wu, J.N., Eiteman, M.A., and Law, S.E. (1998) Evaluation of membrane filtration  
16 and ozonation processes for treatment of reactive-dye wastewater. *J. Environ. Eng. -*  
17 *ASCE*, 124: 272-277.
- 18 148. Ernst, M., and Jekel, M. (1999) Advanced treatment combination for groundwater  
19 recharge of municipal wastewater by nanofiltration and ozonation. *Water Sci.*  
20 *Technol.*, 40: 277-284.
- 21 149. Benner, J., Salhi, E., Ternes, T., and von Gunten, U. (2008) Ozonation of reverse  
22 osmosis concentrate: Kinetics and efficiency of beta blocker oxidation. *Water Res.*,  
23 42: 3003-3012.

- 1 150. Hermosilla, D., Merayo, N., Ordóñez, R. and Blanco, A. (2012) Optimization of  
2 conventional Fenton and ultraviolet-assisted oxidation processes for the treatment of  
3 reverse osmosis retentate from a paper mill. *Waste Manage.*, 32: 1236–1243.
- 4 151. Van Hege, K., Verhaege, M., and Verstraete, W. (2004) Electro-oxidative  
5 abatement of low-salinity reverse osmosis membrane concentrates. *Water Res.*, 38:  
6 1550-1558.
- 7 152. Ersever, I., Ravindran, V., and Pirbazari, M. (2007) Biological denitrification of  
8 reverse osmosis brine concentrates: I. Batch reactor and chemostat studies. *J.*  
9 *Environ. Eng. Sci.*, 6: 503-518.
- 10 153. Sojka-Ledakowicz, J., Zylla, R., Mrozinska, Z., Pazdzior, K., Klepacz-Smolka, A.,  
11 and Ledakowicz, S. (2010) Application of membrane processes in closing of water  
12 cycle in a textile dye-house. *Desalination*, 250: 634-638.
- 13 154. Sperlich, A., Warschke, D., Wegmann, C., Ernst, M., and Jekel, M. (2010)  
14 Treatment of membrane concentrates: phosphate removal and reduction of scaling  
15 potencial. *Water Sci. Technol.*, 61: 301-306.
- 16 155. Kumar, M., Badruzzaman, M., Adham, S., and Oppenheimer, J. (2007) Beneficial  
17 phosphate recovery from reverse osmosis (RO) concentrate of an integrated  
18 membrane system using polymeric ligand exchanger (PLE). *Water Res.*, 41: 2211-  
19 2219.
- 20 156. Ranganathan, K., Karunagaran, K., and Sharma, D.C. (2007) Recycling of  
21 wastewaters of textile dyeing industries using advanced treatment technology and  
22 cost analysis-Case studies. *Resour. Conserv. Recycl.*, 50: 306-318.
- 23 157. Shukla, S.K., Kumar, V., Mudgal, M., Morchhale, R.K., and Bansal, M.C. (2010)  
24 Utilization of concentrate of membrane filtration of bleach plant effluent in brick  
25 production. *J. Hazard. Mater.*, 184: 585–590.

- 1 158. Badruzzaman, M., Oppenheimer, J., Adham, S., and Kumar, M. (2009) Innovative  
2 beneficial reuse of reverse osmosis concentrate using bipolar membrane  
3 electro dialysis and electrochlorination processes. *J. Membr. Sci.*, 326: 392-399.
- 4 159. McDonald, D.H., and Dyack, B. (2004) *Exploring the institutional impediments to*  
5 *conservation and water reuse – National issues. A report for the Australian Water*  
6 *Conservation and Reuse Research Program (AWCRRP). Natural Resource*  
7 *Management Economics 04\_002*; Policy and Economic Research Unit,  
8 Commonwealth Scientific and Industrial Research Organisation (CSIRO) Land and  
9 Water: Adelaide, Australia.
- 10 160. Hird, W. (2006) Recycled water-case study: BlueScope Steel, Port Kembla  
11 Steelworks. *Desalination*, 188: 97-103.
- 12 161. Queensland Government (2007) *Luggage Point Advanced Water Treatment Plant*  
13 *Project Fact Sheet*; Department of Infrastructure and Planning, Queensland  
14 Government: Brisbane, Australia.
- 15 162. Queensland Government. (2008a) *Bundamba Advanced Water Treatment Plant*;  
16 Department of Infrastructure and Planning, Queensland Government: Brisbane,  
17 Australia.
- 18 163. Queensland Government. (2008b) *Gibson Island Advanced Water Treatment*  
19 *Plant*; Department of Infrastructure and Planning, Queensland Government: Brisbane,  
20 Australia.
- 21 164. Cornell, S. (2007) *Camellia Recycled Water Project, Preliminary Environmental*  
22 *Assessment Report*; Alinta, Parsons Brinckerhoff: New York, USA.
- 23 165. De Koning, J., Bixio, D., Karabelas, A., Salgot, M., and Schäfer, A. (2008)  
24 Characterisation and assessment of water treatment technologies for reuse.  
25 *Desalination*, 218: 92-104.

- 1 166. Blair, P.M., and Tuner, N. (2004) *Groundwater – A crucial element of water*  
2 *recycling in Perth, Western Australia*; Water Corporation: Leederville, Perth,  
3 Australia.
- 4 167. Pink, B. (2010) *Water Account Australia 2008-2009*; Australian Bureau of  
5 Statistics (ABS): Canberra, Australia.
- 6 168. Seah, H., Poon, J., Leslie, G., and Law, I.B. (2003) Singapore's NEWater  
7 demonstration project: Another milestone in indirect potable reuse. *Water*, June: 43-  
8 46.
- 9 169. Guest, J.S., Skerlos, S.J., Barnard, J.L., Beck, M.B., Daigger, G.T., Hilger, H.,  
10 Jackson, S.J., Karvazy, K., Kelly, L., MacPherson, L., Mihelcic, J.R., Pramanik, A.,  
11 Raskin, L., Van Loosdrecht, M.C., Yeh, D., and Love, N.G. (2009) A new planning  
12 and design paradigm to achieve sustainable resource recovery from wastewater.  
13 *Environ. Sci. Technol.*, 43: 6126-6130.
- 14 170. Gareth, E. (2008) Singapore's self sufficiency. *Water technology.net*, 10 (June);  
15 Net Resources International: Melbourne, Australia.
- 16 171. Tortajada, C. (2006) Water management in Singapore. *Water Resour. Dev.*, 22:  
17 227-240.
- 18 172. The World Bank (2006) *China water quality management - Policy and*  
19 *institutional considerations. Discussion Papers, September*; Environment and Social  
20 Development Department, East Asia and Pacific Region, The World Bank:  
21 Washington, D.C., USA
- 22 173. ICD (2009) *Wastewater Treatment in China. Shangai*; Innovation Center Denmark  
23 (ICD), Ministry of Foreign Affairs of Denmark: Copenhagen, Denmark.
- 24 174. Israel NEWTech (2010) *National Water Management: The Israeli experience*;  
25 Israel NEWTech, National Water and Energy Program (April), Ministry of Industry

- 1 Trade and Labor, Foreign Trade Administration and Investment Promotion Center:  
2 Jerusalem, Israel.
- 3 175. JLJ Group (2010) New deals in China's wastewater treatment market International  
4 investment cleaning up China's water supply. *China Industry Reports*, April; JLJ  
5 Group: Shanghai, China.
- 6 176. Xuejian, X., and He, X. (2009) Use of reclaimed water in China: management  
7 issues and strategies. *Manage. Sci. Eng.*, 3: 19-25.
- 8 177. Hidalgo, D., and Irusta, R. (2005) *The cost of wastewater reclamation and reuse in*  
9 *agricultural production in the Mediterranean countries*; IWA's International  
10 Conference on Water, Economics, Statistics and Finance (July): Rethymno, Greece.
- 11 178. Murrer, J., and Macbeth, I. (2005) Water reuse-Capturing a waste resource. *Water*  
12 *Env. J.*, 194: 323-327.
- 13 179. Bixio, D., Thoeye, C., De Koning, J., Joksimovic, D., Savic, D., Wintgens, T., and  
14 Melin, T. (2006) Wastewater reuse in Europe. *Desalination*, 187: 89-101.
- 15 180. Melin, T., Jefferson, B., Bixio, D., Thoeye, C., De Wilde, W., and De Koning, J.  
16 (2006) Membrane bioreactor technology for wastewater treatment and reuse.  
17 *Desalination*, 187: 271-282.
- 18 181. Morris, S. (2008) *Application of UF/MBR technology for industrial wastewater*  
19 *reuse*; MIChemE Envirolink Northwest: Birchwood, Warrington, UK.
- 20 182. Institute for Sustainability and Innovation, Victoria University (2008) *Guidance*  
21 *for the use of recycled water by industry*; CSIRO Land and Water – For the Smart  
22 Water Fund, and Victoria University: Melbourne, Australia.
- 23 183. Patel, M. (2010) *The groundwater replenishment system*; Presented to the  
24 Interstate Council on Water Policy (ICWP) on December 1<sup>st</sup>: Arlington, VA, USA.

- 1 184. Comerton, A.M., Andrews, R.C., and Bagley, D.M. (2005) Evaluation of an MBR-  
2 RO system to produce high quality reuse water: Microbial control, DBP formation  
3 and nitrate. *Water Res.*, 39: 3982-3990.
- 4 185. Tam, L.S., Tang, T.W., Lau, G.N., Sharma, K.R., and Chen, G.H. (2006) A pilot  
5 study for wastewater reclamation and reuse with MBR/RO and MF/RO systems.  
6 *Desalination*, 202: 106-113.
- 7 186. Qin, J.J., Kekre, K.A., Tao, G., Oo, M.H., Wai, M.N., Lee, T.C., Viswanath, B.,  
8 Seah, H. (2006) New option of MBR-RO process for production of NEWater from  
9 domestic sewage. *J. Membr. Sci.*, 272: 70-77.
- 10 187. Van der Bruggen, B., and Vandecasteele C. (2003) Removal of pollutants from  
11 surface water and groundwater by nanofiltration: overview of possible applications  
12 in the drinking water industry. *Environ. Pollut.*, 122: 435-445.
- 13 188. Ghayeni, S.B.S., Beatson, P.J., Schneider, R.P., and Fane, A.G. (1998) Water  
14 reclamation from municipal wastewater using combined microfiltration-reverse  
15 osmosis (MF-RO): Preliminary performance data and microbiological aspects of  
16 system operation. *Desalination*, 116: 65-80.
- 17 189. Feini, L., Guoliang, Z., Qin, M., and Hongzi, Z. (2008) Performance of  
18 nanofiltration and reverse osmosis membranes in metal effluent treatment. *Chinese J.*  
19 *Chem. Eng.*, 16: 441-445.
- 20 190. Van der Bruggen, B., Mänttari, M., and Nyström, M. (2008) Drawbacks of  
21 applying nanofiltration and how to avoid them: A review. *Sep. Purif. Technol.*, 63:  
22 251-263.
- 23 191. García-Figueruelo, C., Bes-Pià, A., Mendoza-Roca, J.A., Lora-García, J., and  
24 Cuartas-Urbe, B. (2009) Reverse osmosis of the retentate from the nanofiltration of  
25 secondary effluents. *Desalination*, 240: 274-279.

- 1 192. Webb, L. (2001) Effluent treatment heats up at mills. *Pulp Pap. Int.*, 43:33-37.
- 2 193. Hepp, B., Joore, L., Schonewille, H., and Futselaar, H. (2005) Membrane filtration:  
3 a sustainable water treatment technology within modern papermaking concepts. *Pap.*  
4 *Technol.*, 46: 41-48.
- 5 194. Zippel, F. (2001) *Water management in paper mills* (2<sup>nd</sup> Ed); F. Zippel:  
6 Heidenheim, Germany.
- 7 195. Webb, L. (2002) Kidney technology brings success. *Pulp Pap. Int.*, 44: 26:32.
- 8 196. Toshiba Corporation. *Efficient Use of Water. Case study 3: Wastewater recycling*  
9 *at a semiconductor plant* [Online]; Toshiba Corporation: Tokyo, Japan [ref. October  
10 5<sup>th</sup>, 2012]: <<http://www.toshiba.co.jp/env/en/industry/water.htm>>
- 11 197. Abou-Elela, S.I., Nasr, F.A., Ibrahim, H.S., Badr, N.M., and Askalany, A.R.M.  
12 (2008) Pollution prevention pays off in a board paper mill. *J. Clean Prod.*, 16: 330-  
13 334.
- 14 198. Prasad, P., Pagan, R., Kauter, M., and Price, N. (2004) *Eco-efficiency for the dairy*  
15 *processing industry*; United Nations Environment Programme's (UNEP) Working  
16 Group for Cleaner Production in the Food Industry, Environmental Management  
17 Centre, University of Queensland: Brisbane St. Lucia, Australia.
- 18 199. SDLA (1993) *Annual Status Report on Reclaimed Water Use*; Sanitation Districts  
19 of Los Angeles County (SDLA): Whittier, California.
- 20 200. Tsiridis, V., Kougolos, A., Kotios, A., Plageras, P., and Saratsis, Y. (2009)  
21 Wastewater reclamation and reuse. *Discuss. Pap. Ser.*, 15: 139-148.
- 22 201. Dolnicar, S., and Schäfer, A.I. (2006) *Public perception of desalinated versus*  
23 *recycled water in Australia*; American Water Works Association's (AWWA)  
24 Desalination Symposium (May 7<sup>th</sup> – 9<sup>th</sup>): Honolulu, Hawaii, USA.

- 1 202. Russell, S., and Hampton, G. (2006) Challenges in understanding public responses  
2 and providing effective public consultation on water reuse. *Desalination*, 187: 215-  
3 227.
- 4 203. Asano, T., Burton, F.L., Leverenz, H.L., Tsuchihashi, R., and Tchobanoglous, G.  
5 (2007) *Water reuse: Issues, technologies and applications* (1<sup>st</sup> Ed.); Metcalf and  
6 Eddy Inc. / AECOM (The McGraw Hill Companies): Wakefield, MA, United States.
- 7 204. WCWA (2003) *Kwinana water reclamation plant (KWRP): Expanding Perth's*  
8 *water options. Use of cape Peron outlet pipeline to dispose of industrial wastewater*  
9 *to Sepia Depression, Kwinana. Public Environmental Review* (November); Water  
10 Corporation of Western Australia (WCWA): Leederville, WA, Australia.
- 11 205. Barwon Water (2010) *Northern Water Plant, Recycling at the Shell Refinery in*  
12 *Geelong. Community Information Bulletin, February*; Barwon Water, Geelong,  
13 Victoria.
- 14 206. Chapman, H. (2006) WRAMS, sustainable water recycling. *Desalination*, 188:  
15 105-111.
- 16 207. DTI (2006) *Water recycling and reuse in Singapore and Australia. DTI Report of a*  
17 *Global Watch Mission, November*; Department of Trade and Industry (DTI): London,  
18 UK.
- 19 208. ROPV (2010) *Sembcorp Changi NEWater Plant (SCNP) Case Study. Project*  
20 *Snapshot*; ROPV: Harbin, P.R. China.
- 21 209. Drioli, E., and Macedonio, F. (2010) *Report on membrane research, membrane*  
22 *production and membrane application in China*; Institute on Membrane Technology,  
23 Italian National Research Council (ITM-CNR): Rende, Calabria, Italy.
- 24 210. Elsevier's Pump Industry Analyst (2010) Hyflux awarded S\$35.8mn contract for  
25 Singapore's largest MBR plant. *Pump Industry Analyst*, 2: 2.

- 1 211. Inge (2009) Reclamation of municipal wastewater for a Chinese petrochemical  
2 complex; Inge GmbH: Greifenberg, Germany.
- 3 212. DOW Chemical (2008) *Case study: DOW™ ultrafiltration modules protect*  
4 *reverse osmosis system from high iron. Form No. 795-00021-1108*; DOW Chemical:  
5 Midland, MI, USA.
- 6 213. Kalinske, A.A., Willis, J.F., and Martin, S.R. (1979) Reclamation of wastewater  
7 treatment plant effluent for high quality industrial reuse in Saudi Arabia.  
8 *Proceedings of the Water Reuse Symposium: Water reuse – From research to*  
9 *application*, pp. 958-993; American Water Works Association (AWWA): Denver,  
10 Colorado.
- 11 214. El-Rehaili, A. (1991) Reverse osmosis applications in Saudi Arabia. *J. AWWA*, 83:  
12 72-79.
- 13 215. Abdel-Jawad, M., Al-Shammari, S., and Al-Sulaimi, J. (2002) Non-conventional  
14 treatment of treated municipal wastewater for reverse osmosis. *Desalination*, 142:  
15 11-18.
- 16 216. Gagne, D. (2005) The world's largest membrane-based water reuse project. *GE*  
17 *Water & Process Technologies Technical paper*; GE Infrastructure Water & Process  
18 Technologies: Watertown, MA, USA.
- 19 217. Judd, S., and Bennet, A. (2004) Membrane technology recovers water for  
20 industrial reuse. *Water & Wastewater Int.*, 19: 13-14.
- 21 218. ICF Jones and Stokes (2010) *South Bay Advanced Recycled Water Treatment*  
22 *Facility Final Environmental Assessment/Initial Study-Mitigated Negative*  
23 *Declaration*; US Bureau of Reclamation, Mid-Pacific Region (Sacramento, CA),  
24 Santa Clara Valley Water District: San José, CA, USA.

- 1 219. Wingfield, T., and Schaefer, J. (2002) Membrane separation provides recovery of  
2 high value products and transforms wastewater into a renewable water resource.  
3 *Cleaner Purer Water*, PE 9/02 (Reprinted from *Pollution Engineering*, Copyright  
4 September 2002); Pall Corporation: Tokyo, Japan.
- 5 220. Lazarova, V. (2001) *Recycled water: technical-economic challenges for its*  
6 *integration as a sustainable alternative resource*; UNESCO International  
7 Symposium “*Les frontières de la Gestion de l’eau urbaine: impasse ou espoir?*”,  
8 June 18<sup>th</sup> - 20<sup>th</sup>: Marseille, France
- 9 221. Castro, D.J., and Sasis, R.P. (2003) *Innovative water treatment design for turning*  
10 *wastewater treatment effluent into boiler makeup water*; 11<sup>th</sup> North American Waste  
11 to Energy Conference (NAWTEC): Tampa, FL, USA.
- 12 222. Water technology.net. *City of North Las Vegas Water Reclamation Facility, USA*.  
13 [Online]; Net Resources International: Melbourne, Australia [ref. October 4<sup>th</sup>, 2012]:  
14 <<http://www.water-technology.net/projects/cityofnorthlasvegas/>>
- 15 223. GE W&PT (2008) *Case study: Kyrene Water Reclamation Plant (CS-KYRENE-*  
16 *MUNWW-EN-1106-NA)*; GE Infrastructure Water & Process Technologies:  
17 Watertown, MA, USA.
- 18 224. Rimer, A.E., Kobylnski, E.A., Hunter, G.L., DiGiano, F.A., and Bierck, B. (2008)  
19 *The impacts of membrane process residual on wastewater treatment. Guidance*  
20 *manual*; Water Reuse Research Foundation: Alexandria, VA, USA
- 21 225. Filteau, G., Whitley, C., and Watson, I.C. (1995) Water reclamation fuels  
22 economic growth in Harlingen, Texas. Reclamation of municipal wastewater for  
23 industrial process use. *Desalination*, 103: 31-37.

- 1 226. Durham, B., Bourbigot, M.M., and Pankratz, T. (2001) Membranes as pre-  
2 treatment to desalination in wastewater reuse: operating experience in the municipal  
3 and industrial sectors. *Desalination*, 138: 83-90.
- 4 227. GE W&PT (2008) *Case Study: City of Edmonton Gold Bar Wastewater Treatment*  
5 *Plant (CS-GOLD-MUNWW-EN-1106-NA)*; GE Infrastructure Water & Process  
6 Technologies: Watertown, MA, USA.
- 7 228. Ramos, R., Aerts, P., Guzman, E., and Pacheco, J. (2010) Case study: Mining  
8 company reclaims wastewater in Mexico. *Environmental Protection*, June 14<sup>th</sup>.

**Table 1.** Quality guidelines that reclaimed water must fulfill for its use as fresh water in different industrial applications.

Parameter	PAPER GRADES (61)									TEXTILE (5)					
	Cooling (37)	Boiler (37, 38)	Sealing (55)	Groundwood	Soda & sulphate (Kraft)	Kraft bleached	Unbleached	Bleached	Recycled (high pressure showers)	Sizing suspension	Scouring, bleaching, dyeing	Electronic (83)	Chemical (88)	Pharmaceutical <sup>a</sup> (56)	Petrochem / Coal (88)
T,°C	-	-	<20-30	<55	27	-	-	15-27	-	-	19-21	-	-	-	-
pH	6.9-9.0	8.2-10.0	>7.0	-	-	-	-	-	6.5-7.5	-	-	6.5-7.5	6.2-8.3	-	6-9
TSS, mg/L	100	5	-	40	10	10	10-30	10-30	<5	5	5	-	5	-	10
TDS, mg/L	500	700	<1000	250-1000	250-1000	300	75-650	75-650	<300	100	100	-	1000	-	1000
Conductivity, mS/cm	-	-	<2.0	-	-	-	-	-	<0.5	-	-	-	-	≤1.1	-
Turbidity, NTU	50	-	-	70	35	40	140	14-56	-	-	-	-	-	-	-
Colour, PCU	-	-	-	30	5	25	30-100	5-25	<30	5	5	-	20	-	-
COD, mg/L	75	5	-	-	-	-	-	-	<5	-	-	-	-	-	-
BOD <sub>5</sub> , mg/L	25	-	-	-	-	-	-	-	-	-	-	-	-	-	-
TOC, mg/L	-	-	-	-	-	-	-	-	-	-	-	0.25	-	0.5	-
Hardness, mgCaCO <sub>3</sub> /L	650	1.0	<200	100-200	100-200	100	200	100	<200	25	25	-	250	-	350
Alkalinity, mgCaCO <sub>3</sub> /L	350	100	-	75-150	75-150	75	150	75-125	<100	-	-	-	125	-	-
Ammonia-N, mg/L	1.0	0.1	-	-	-	-	-	-	<0.5	-	-	-	-	-	-
PO <sub>4</sub> <sup>3-</sup> , mg/L	4.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-
HCO <sub>3</sub> <sup>-</sup> , mg/L	24	120	-	-	-	-	-	-	-	-	-	-	128	-	-
NO <sub>3</sub> <sup>-</sup> , mg/L	-	-	-	-	-	-	-	-	-	-	-	-	5	≤0.2	-
Si, mgSiO <sub>2</sub> /L	50	10	-	50	20	50	100	9-20	<5	-	-	-	50	-	-

<sup>a</sup>Data are for highly purified water class; <sup>b</sup>Heavy metals in general must be ≤ 0.1 mg/L.

**Table 1 (continuation).** Quality guidelines that reclaimed water must fulfill for its use as fresh water in different industrial applications.

Parameter	PAPER GRADES (61)									TEXTILE (5)					
	Cooling (37)	Boiler (37, 38)	Sealing (55)	Groundwood	Soda & sulphate (Kraft)	Kraft bleached	Unbleached	Bleached	Recycled (high pressure showers)	Sizing suspension	Scouring, bleaching, dyeing	Electronic (83)	Chemical (88)	Pharmaceutical <sup>a</sup> (56)	Petrochem / Coal (88)
Al, mg/L	0.1	0.1	-	-	-	-	-	-	0.1	-	-	-	-	-	-
Fe, mg/L	0.5	0.3	-	0.3	0.1	0.2	1.0	0.1	<0.1	0.3	0.1	-	<sup>b</sup>	0.1	1.0
Mn, mg/L	0.5	0.1	-	0.1	0.05	0.1	0.5	0.03	<0.05	0.05	0.01	-	<sup>b</sup>	0.1	-
Ca, mg/L	50	0.4	-	-	-	-	-	-	<60	-	-	-	-	68	75
Mg, mg/L	0.5	0.25	-	-	-	-	-	-	<15	-	-	-	-	19	30
SO <sub>4</sub> <sup>2-</sup> , mg/L	200	-	<200	trace	-	-	-	100-300	<100	-	-	-	-	100	-
Cl <sup>-</sup> , mg/L	500	-	<200	75	75	200	200	200	<50	-	-	-	-	500	300
Cu, mg/L	-	0.05	-	-	-	-	-	-	<0.001	0.01	-	-	<sup>b</sup>	-	0.05
Zn, mg/L	-	0.01	-	-	-	-	-	-	-	-	-	-	<sup>b</sup>	-	-
Na, mg/L	-	-	-	-	-	-	-	-	-	-	-	0.01	-	-	-
Dissolved oxygen, mg/L	-	0.007	-	-	-	-	-	-	-	-	-	-	-	-	-
Methylene-blue active substances	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-
Carbon tetrachloride extract	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-
Evaporation residue, mg/L	-	-	-	-	-	-	-	-	-	-	-	0.5	-	-	-
Resistivity, MΩ·cm at 25°C	-	-	-	-	-	-	-	-	-	-	-	>18	-	-	-
Abrasive matter (>10µm)	-	-	<40-50	-	-	-	-	-	-	-	-	-	-	-	-
Aerobic bacteria (CFU/mL)	-	-	-	-	-	-	-	-	-	-	-	-	≤10	-	-
Bacteria endotoxins (IU/mL)	-	-	-	-	-	-	-	-	-	-	-	-	≤0.25	-	-

<sup>a</sup>Data are for highly purified water class; <sup>b</sup>Heavy metals in general must be ≤ 0.1 mg/L.

**Table 2.** Effect of common foulants on membrane performance (104, 106-109).

<b>FOULANT TYPE</b>	<b>SALT PASSAGE</b>	<b>PRESSURE DROP</b>	<b>PRODUCT FLOW</b>
Inorganic salts	10-15% increase	10-40% increase	<10% decrease
Metal (hydro)oxides	>200% rapid increase	>200% rapid increase	20-40% decrease
Colloids	>200% gradual increase	>200% gradual increase	>50% gradual increase
Organic matter	increase or decrease	small increase	>50% decrease
Biofouling	> 200% rapid decrease	>200% rapid increase	>50% decrease

**Table 3.** Wastewater reclamation facilities based on membrane systems located in Australia.

<b>FACILITY NAME</b>	<b>LOCATION</b>	<b>SYSTEM</b>	<b>APPLICATION</b>
Bundamba AWTP <sup>a</sup> (162)	Ipswich	MF + RO + UV	Cooling water
Eraring Power Station (1)	Lake Macquarie	MF + RO <sup>e</sup>	Boiler makeup water Cooling water
Gibson Island AWTP <sup>a</sup> (163)	Brisbane	MF + RO + UV	Power stations
Kwinana Water Reuse Project (204)	Perth	MF + RO <sup>e</sup>	- <sup>d</sup>
Luggage Point WTP <sup>b</sup> (160)	Brisbane	MF + RO <sup>e</sup>	- <sup>d</sup>
Luggage Point AWTP <sup>a</sup> (161)	Brisbane	MF + RO <sup>e</sup>	Boiler feed water Cooling tower make-up Other process uses
Northern Water Plant (205)	Victoria	UF + RO <sup>e</sup>	Refinery
Illawarra RWP <sup>c</sup> (160)	Sydney	MF + RO <sup>e</sup>	At Bluescope Steel facility
WRAMS-2000 Olympic Site (206)	Sydney	MF + RO + UV	- <sup>d</sup>

Secondary treatment is specified when RO is used without membrane pretreatment. <sup>a</sup>AWTP: Advanced Water Treatment Plant; <sup>b</sup>WTP: Water Treatment Plant; <sup>c</sup>RWP: Recycled Water Plant; <sup>d</sup>Industrial, but not specified; <sup>e</sup>Not specified whether disinfection exists after RO.

**Table 4.** Wastewater reclamation facilities based on membrane systems located in Asia.

<b>FACILITY NAME</b>	<b>LOCATION</b>	<b>SYSTEM</b>	<b>APPLICATION</b>
Bedok NEWater plant (23, 207)	Bedok/Singapore	UF + RO + UV	Electronics industry Wafer fabrication Air conditioning Cooling water Boiler feed water
Kranji NEWater plant (23, 209)	Kranji/Singapore	MF + RO + UV	Electronics industry Wafer fabrication Air conditioning Cooling water Boiler feed water
Seletar NEWater plant (23, 209)	Seletar/Singapore	MF + RO + UV	Electronics industry Wafer fabrication Air conditioning Cooling water Boiler feed water
Changi NEWater (210)	Changi/Singapore	UF + RO + UV	Electronics industry Wafer fabrication Air conditioning Cooling water Boiler feed water
Ulu Pandan NEWater plant (23, 186)	Ulu Pandan/Singapore	MF + RO + UV	Electronics industry Wafer fabrication Air conditioning Cooling water Boiler feed water
Xinxinban WWTP <sup>a</sup> (209)	Hohhot/China	MBR + IE <sup>l</sup>	Cooling water

Secondary treatment is specified when RO is used without membrane pretreatment. <sup>a</sup>WWTP: Wastewater Treatment Plant; <sup>b</sup>WRP: Water Recycling Plant; <sup>c</sup>STP: Sewage Treatment Plant; <sup>d</sup>Industrial, but not specified; <sup>e</sup>Not specified whether disinfection exists after the last treatment; <sup>f</sup>SF: Sand filter; <sup>g</sup>EDI: Electrodeionization; <sup>h</sup>CMF: Classical matched filter; <sup>i</sup>CF: Cartridge filter; <sup>j</sup>GF: Gravity filter; <sup>k</sup>AC: Activated carbon; <sup>l</sup>IE: Ionic exchange.

**Table 4 (continuation).** Wastewater reclamation facilities based on membrane systems located in Asia.

FACILITY NAME	LOCATION	SYSTEM	APPLICATION
Jurong WRP <sup>b</sup> (210)	Jurong Island/Singapore	SF <sup>f</sup> + RO <sup>e</sup>	_ <sup>d</sup>
Jurong WRP <sup>b</sup> (210)	Jurong Island/Singapore	MBR <sup>e</sup>	_ <sup>d</sup>
CNPC Dalian Petrochemical Company Ltd. (211)	Dalian/China	UF + RO <sup>e</sup>	Boiler feed water
ShanXi DaTong Co-gen Ltd. (212)	DaTong/China	UF + RO + EDI <sup>g</sup>	Boiler feed water
Tianjin Ji Zhuang Zi STP <sup>c</sup> (8)	Tianjin/China	MF <sup>e</sup>	_ <sup>d</sup>
Tianjin TEDA STP <sup>c</sup> (8)	Tianjin/China	MF + RO <sup>e</sup>	_ <sup>d</sup>
STP of Beijing EDA (176)	Beijing/China	CMF <sup>h</sup> + RO <sup>e</sup>	Process water
Gajwa WWTP (9)	West Inchen/North Korea	Flocculation + media filtration + RO <sup>e</sup> (MF is applied to protect RO against process breakdown)	Cooling water
Sewage Treatment of Changshou industry park (176)	Changshou/China	UF <sup>e</sup>	Cooling water Boiler make-up water Industrial process water
Madras Fertilizers Limited (8)	Chennai/India	SF <sup>f</sup> + ammonia stripping + carbonation + chlorination + filtration + dechlorination + CF <sup>i</sup> + RO <sup>e</sup>	Cooling tower makeup
Petromin Refinery (Aramco) (213, 214)	Riyadh/Saudi Arabia	Lime clarification + GF <sup>j</sup> + AC <sup>k</sup> + RO + decarbonation + IE <sup>l</sup>	Cooling tower makeup Desalter water makeup Boiler feed water
Sulaibiya WWTP (215, 216)	Sulaibiya/Kuwait	UF+RO+UV	_ <sup>d</sup>

Secondary treatment is specified when RO is used without membrane pretreatment. <sup>a</sup>WWTP: Wastewater Treatment Plant; <sup>b</sup>WRP: Water Recycling Plant; <sup>c</sup>STP: Sewage Treatment Plant; <sup>d</sup>Industrial, but not specified; <sup>e</sup>Not specified whether disinfection exists after the last treatment; <sup>f</sup>SF: Sand filter; <sup>g</sup>EDI: Electrodeionization; <sup>h</sup>CMF: Classical matched filter; <sup>i</sup>CF: Cartridge filter; <sup>j</sup>GF: Gravity filter; <sup>k</sup>AC: Activated carbon; <sup>l</sup>IE: Ionic exchange.

**Table 5.** Wastewater reclamation facilities based on membrane filtration systems located in Europe.

<b>FACILITY NAME</b>	<b>LOCATION</b>	<b>SYSTEM</b>	<b>APPLICATION</b>
Cuenca Media-Alta de Arroyo Culebro WWTP <sup>a</sup> (4)	Madrid/Spain	SF + AC + UF + RO + UV	Process water in a paper mill Cooling tower makeup Boiler feed water
Flag Fen Sewerage Treatment Plant (217)	Peterborough/UK	MF+ chloramines +RO +IE	Boiler feed water
E.C. Katowice Power Plant (181)	Katowice/Poland	UF	Cooling water
Villefranche (180)	Villefranche/France	MBR	Washing water in a tannery
Empoli MWRf (179)	Florence/Italy	MBR	Industrial (but not specified)
Collegno (180)	Turin/Italy	SF + UF + AC	Industrial (but not specified)

Secondary treatment is specified when RO is used without membrane pretreatment <sup>a</sup>WWTP: Wastewater Treatment Plant; <sup>b</sup> \*Type of disinfection not specified; \*\* Not specified whether disinfection exists after RO. MWRf: Municipal Water Reclamation Facility. SF: Sand filtration; CF: Cartridge filtrate; IE: Ionic exchange; AC: Activated carbon; DMF: Dual media filters.

**Table 6.** Wastewater reclamation facilities based on membrane systems located in America.

<b>FACILITY NAME</b>	<b>LOCATION</b>	<b>SYSTEM</b>	<b>APPLICATION</b>
South Bay ARWTF <sup>a</sup> ICF (218)	Sta. Clara & S. Jose/ California	MF+RO+UV	Cooling and processing
Toppan Electronic WWTP <sup>b</sup> (219)	San Diego/California	MF + RO <sup>d</sup>	Process water
Millender-McDonald Carson Regional WRP <sup>c</sup> (8)	Carson/California	MF + RO <sup>d</sup>	Cooling tower makeup
Mobil Boiler Feed Facility (8)	Torrance/ California	MF + RO <sup>d</sup>	Boiler feed water
West Basin WRP <sup>c</sup> (220)	El Segundo/California	MF + RO <sup>d</sup>	Boiler feed water
Terminal Island Treatment Plant (8)	Los Angeles/California	MF + RO + chlorination	Boiler feed water
Pinellas County Resource Recovery Facility (221)	Pinellas/Florida	MF + RO + chlorination	Boiler feed water
City of North Las Vegas WRP <sup>c</sup> (222)	Las Vegas/Nevada	MBR + chlorination	Cooling water
Kyrene WRP <sup>c</sup> (223)	Tempe/Arizona	MBR + UV	Industrial processing
Wyodak Power Plant (200)	Gillette/Wyomin	SF +CF +RO + recarbonation +IE	Boiler make-up Dust suppression
Redbud Power Plant (224)	Luther/Oklahoma	Secondary + RO <sup>d</sup>	Cooling tower makeup Boiler feed water
Harlingen WWTP <sup>b</sup> (225)	Harlingen/Texas	SF + RO <sup>d</sup>	Process water
Honouliulu WWTP <sup>b</sup> (226)	Eva Beach/Hawaii	MF + RO + disinfection <sup>e</sup>	Boiler feed water
City of Edmonton Gold Bar WWTP <sup>b</sup> (227)	Edmonton/Canada	UF + RO <sup>d</sup>	Hydrogen and steam production Process alternate feedstocks
Met-Mex Peñoles (228)	Torreon/Mexico	DMF <sup>f</sup> + AC <sup>g</sup> + CF <sup>h</sup> + RO <sup>d</sup>	Cooling tower makeup Boiler feed water Zinc electrolytic process

Secondary treatment is specified when RO is used without membrane pretreatment. <sup>a</sup>ARWTF: Advanced Recycled Water Treatment Facility; <sup>b</sup>WWTP: Wastewater Treatment Plant; <sup>c</sup>WRP: Water Reclamation Facility; <sup>d</sup>Not specified whether disinfection exists after RO; <sup>e</sup>Type of disinfection not specified; <sup>f</sup>DMF: Dual media filters; <sup>g</sup>AC: Activated carbon; <sup>h</sup>CF: Cartridge filter.

**Table 7.** Removal efficiencies (%) of different treatments applied to reclaim municipal sewage (4, 203).

<b>Parameter</b>	<b>CAS<sup>a</sup></b>	<b>CAS + filtration</b>	<b>CAS +BNR<sup>b</sup></b>	<b>CAS +BNR + filtration</b>	<b>MBR</b>	<b>MBR +IE</b>	<b>CAS +MF / UF +RO MBR+RO</b>
TSS, mg/L	96-94	98	95-96	99	>98	>98	>99
TDS, mg/L	0	0-19	0-19	0-19	0-19	-	85-98
VOCs, µm	90	90	90-95	90-95	90-95	90-95	>99
COD, mg/L	84-90	88-91	92-95	92-96	>96	>96	96-99
BOD <sub>5</sub> , mg/L	93-95	94-95	95-96	98-99	>99	>99	>99
TOC, mg/L	85-88	88-90	90-92	98-99	>98	>98	99.0-99.9
Total nitrogen, mg/L	25-50	25-50	85-89	90-93	>86 <sup>c</sup>	>80	>95
Total phosphorous, mg/L	0-17	0-33	75-83	>83	58-93 <sup>d</sup>	>80	>86
Metals, mg/L	33-40	33-40	33-40	33-40	trace	trace	-
Total coliforms, CFU/100mL	99.0-99.9	>99.9	99.0-99.9	99.0-99.9	>99.9	>99.9	~100
Protozoan cysts and oocysts, CFU/100 mL	0-99.9	>99.9	>99.9	>99.9	>99.9	>99.9	~100
Viruses, PFU/100mL	0-90.0	0-99.9	0-90.0	0-90.0	>90	>90	~100

<sup>a</sup>CAS: conventional activated sludge + nitrification. <sup>b</sup>BNR: biological nutrient (N and P) removal ; <sup>c</sup>With anoxic stage; <sup>d</sup>With coagulant addition.

**Figure 1.** Water consumption for cooling towers at thermoelectric power plants (38).

**Figure 2.** Maximum and minimum fresh water consumption values in paper mills (55) and textile industry (65). Data are scaled by tonne of final product.

**Figure 3.** Water consumption thresholds (maximum and minimum) within food industry (74). Data are scaled per tonne of product\*, or per tonne of raw material\*\*.

**Figure 4.** Worldwide distribution of municipal water reclamation facilities where reclaimed water is used for industrial activities.

**Figure 1**

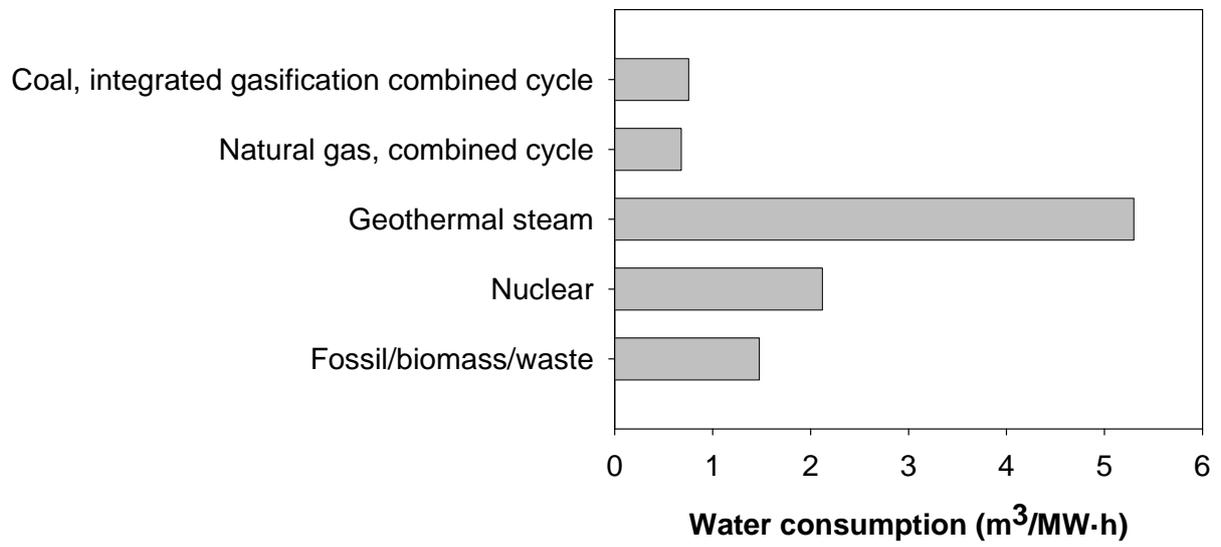


Figure 2


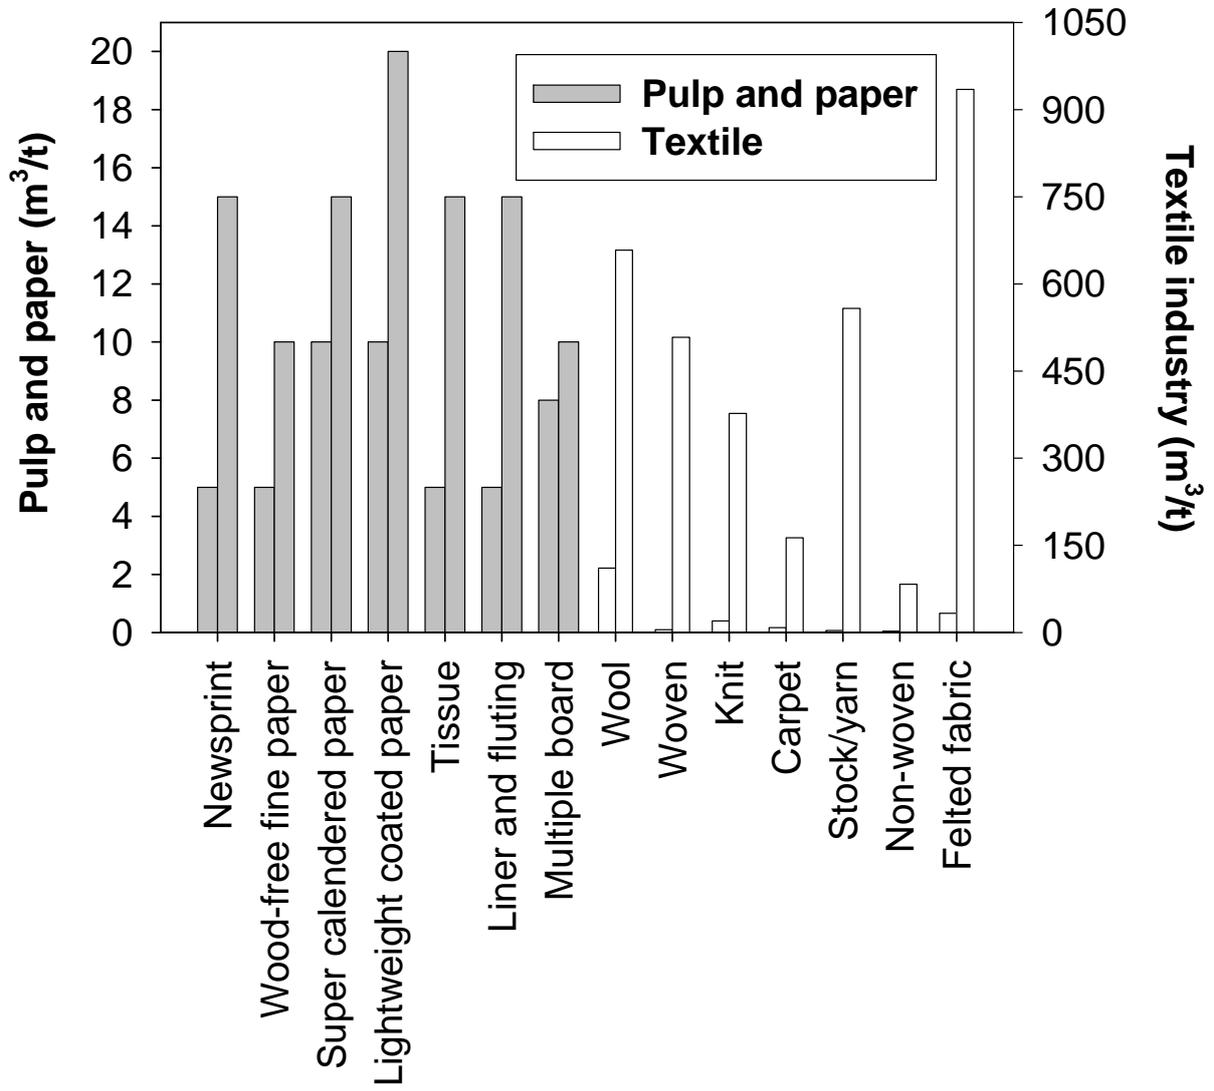


Figure 3



**Figure 4**

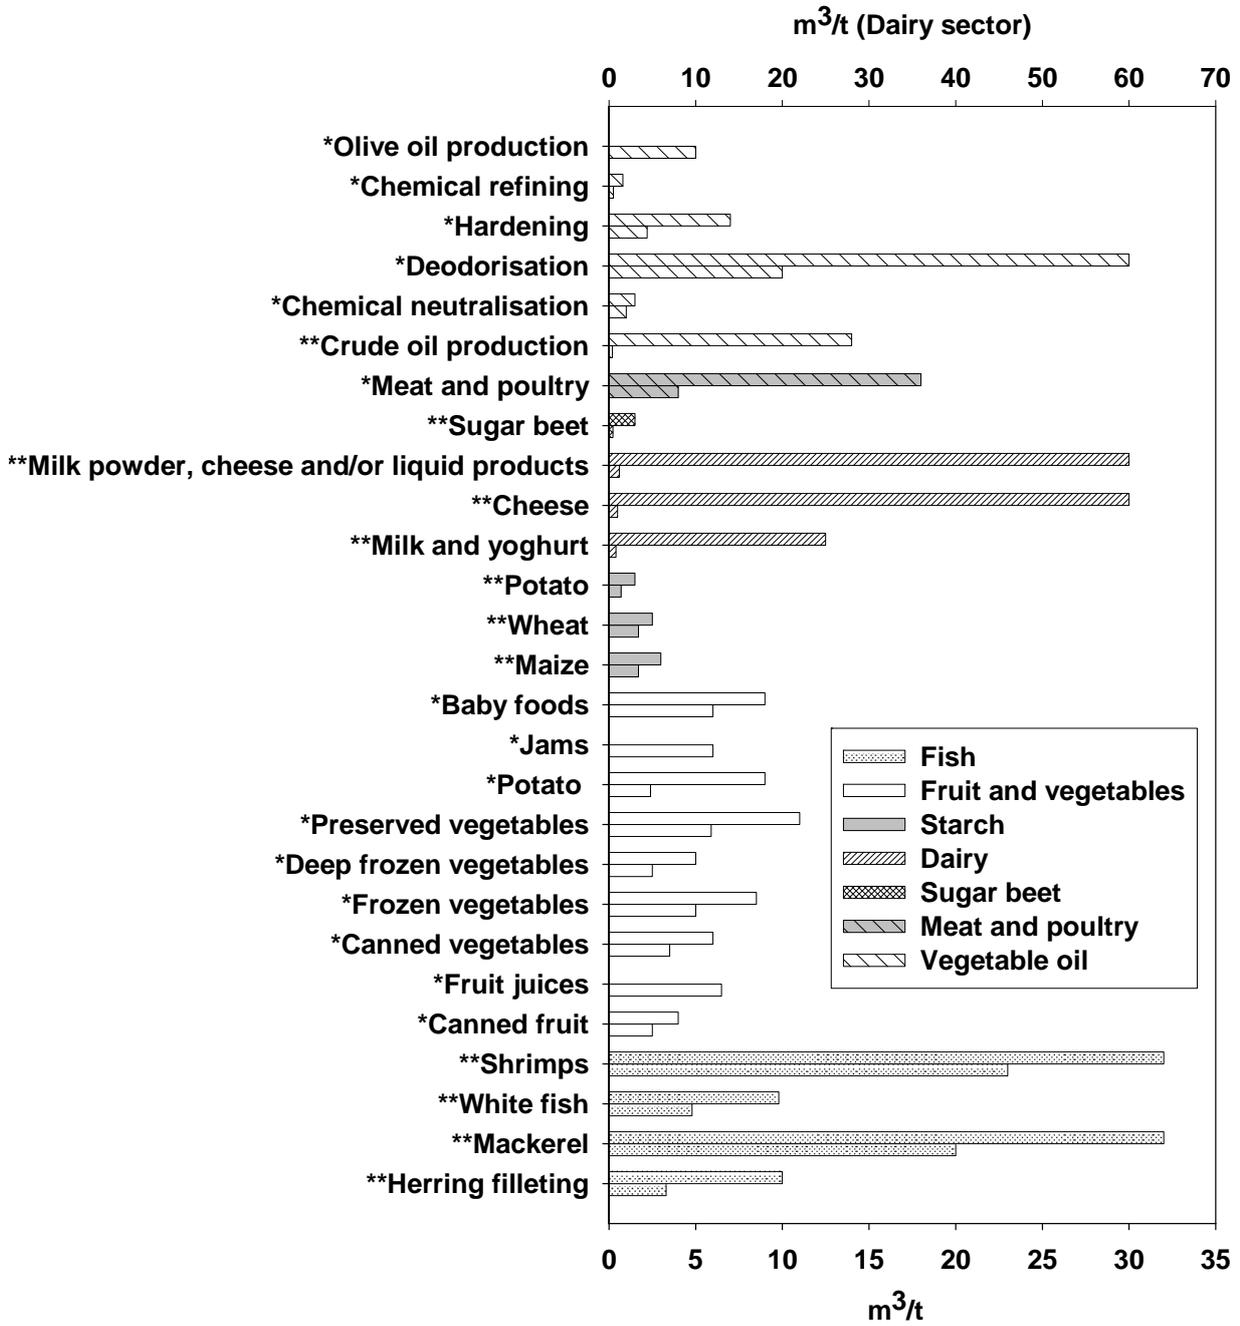

Capacity (m <sup>3</sup> /day)	Membrane technologies	Other technologies
< 6,000		
6,000 – 35,000		
35,000 – 100,000		
> 100,000		
Non-available information		